

MLGPA

Montana Liquid & Gas
Pipeline Association



COORDINATED RESPONSE EXERCISE[®]

Pipeline Safety Training For First Responders



EMERGENCY RESPONSE MANUAL PROGRAM GUIDE

Overview

Operator Profiles

Emergency Response

NENA Pipeline Emergency Operations

Signs of a Pipeline Release

High Consequence Area Identification

Pipeline Industry ER Initiatives

Pipeline Damage Reporting Law

2022

Emergency Contact List

COMPANY	EMERGENCY NUMBER
Bayou Midstream Bakken.....	1-888-489-2747
Belle Fourche Pipeline Company	1-866-305-3741
Bridger Pipeline LLC.....	1-866-305-3741
Butte Pipeline Company	1-866-305-3741
Calumet Montana Refining, LLC	1-406-761-4100
Cenex Pipeline, LLC.....	1-800-421-4122
Colorado Interstate Gas Company	1-877-712-2288
Energy West.....	1-800-570-5688
Energy West (Cascade county).....	1-406-791-7500
Energy West (Gallatin county)	1-406-646-4437
Energy West (Glacier county).....	1-406-873-5533
Express Pipeline LLC (Enbridge)	1-800-858-5253
Exxon Mobile Pipeline Company.....	1-800-537-5200
Front Range Pipeline, LLC	1-800-421-4122
Havre Pipeline Company.....	1-406-357-2233
Montana-Dakota Utilities Company	1-800-638-3278
MPLX - Andeavor Field Services LLC	1-866-283-7676
NorthWestern Energy	1-888-467-2669
ONEOK NGL Pipeline, L.L.C.....	1-800-666-9041
ONEOK Rockies Midstream, LLC	1-800-778-7834
Phillips 66 Pipelines LLC	1-877-267-2290
Plains Pipeline – Belfield Pipeline	1-800-708-5071
TC Energy / Bison Pipeline LLC.....	1-800-447-8066
TC Energy / Northern Border Pipeline Company	1-800-447-8066
WBI Energy Transmission	1-888-859-7291

Note: The above numbers are for emergency situations.

Additional pipeline operators may exist in your area.

Visit the National Pipeline Mapping System at www.npms.phmsa.dot.gov for companies not listed above.

ONE-CALL SYSTEM	PHONE NUMBER
Montana811	1-800-424-5555
Montana 811 (Lincoln and portions of Lake Counties)	1-800-551-8344
National One-Call Referral Number.....	1-888-258-0808
National One-Call Dialing Number	811

Table of Contents

Sponsor Listing.....	1
Overview.....	2
Training Presentation	4
Hazardous Liquids Material Data Sheet.....	17
Highly Volatile Liquids Material Data Sheet.....	18
Natural Gas Material Data Sheet.....	19
Emergency Response Guidebook.....	20
Bayou Midstream Bakken	21
Belle Fourche Pipeline Company / Bridger Pipeline LLC / Butte Pipeline Company	22
Calumet Montana Refining, LLC	23
Cenex Pipeline, LLC.....	24
Colorado Interstate Gas Company	25
Energy West.....	26
Express Pipeline LLC (Enbridge)	27
ExxonMobil Pipeline Company.....	28
Front Range Pipeline, LLC	30
Havre Pipeline Company.....	31
Montana-Dakota Utilities Company	33
MPLX - Andeavor Field Services LLC	34
NorthWestern Energy	36
ONEOK NGL Pipeline, L.L.C.....	38
ONEOK Rockies Midstream, LLC	40
Phillips 66 Pipelines LLC.....	42
Plains Pipeline - Belfield Pipeline	44
TC Energy / Bison Pipeline LLC.....	45
TC Energy / Northern Border Pipeline Company	47
WBI Energy Transmission	48
Emergency Response	49
NENA Pipeline Emergency Operations - Call Intake Checklist	51
Pipelines In Our Community / Pipeline Markers / Call Before You Dig.....	52
Signs Of A Pipeline Release / What To Do If A Leak Occurs / Pipeline Emergency.....	53
High Consequence Areas Identification / Identified Sites.....	54
Maintaining Safety and Integrity of Pipelines / How You Can Help Keep Pipelines Safe / NPMS / Training Center	55
Pipeline Damage Reporting Law / Websites	56
About Paradigm.....	57

To: ALL EMERGENCY OFFICIALS
From: Montana Liquid & Gas Pipeline Association
Re: Pipeline Emergency Response Planning Information

This material is provided to your department as a reference to pipelines that operate in your state in case you are called upon to respond to a pipeline emergency.

For more information on these pipeline companies, please contact each company directly. You will find contact information for each company represented throughout the material.

This information only represents the pipeline and/or gas companies who work with our organization to provide training and communication to Emergency Response agencies such as yours. There may be additional pipeline operators in your area that are not represented in this document.

For information and mapping on other Transmission Pipeline Operators please visit the National Pipeline Mapping System (NPMS) at:
<https://www.npms.phmsa.dot.gov>.

For information on other Gas and Utility Operators please contact your appropriate state commission office.


Further product-specific information may be found in the US Department of Transportation (DOT) *Emergency Response Guidebook for First Responders*.

The Guidebook is available at:
<https://www.phmsa.dot.gov/sites/phmsa.dot.gov/files/2021-01/ERG2020-WEB.pdf>.

Pipeline Emergency Response **PLANNING INFORMATION**

ON BEHALF OF:

Bayou Midstream Bakken
Belle Fourche Pipeline Company
Bridger Pipeline LLC
Butte Pipeline Company
Calumet Montana Refining, LLC
Cenex Pipeline, LLC.
Colorado Interstate Gas Company
Energy West
Express Pipeline LLC (Enbridge)
ExxonMobil Pipeline Company
Front Range Pipeline, LLC
Havre Pipeline Company
Montana-Dakota Utilities Company
MPLX - Andeavor Field Services LLC
NorthWestern Energy
ONEOK NGL Pipeline, L.L.C.
ONEOK Rockies Midstream, LLC
Phillips 66 Pipelines LLC
Plains Pipeline – Belfield Pipeline
TC Energy / Bison Pipeline LLC
TC Energy / Northern Border Pipeline Company
WBI Energy Transmission

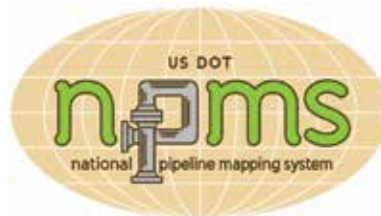

Note: The enclosed information to assist in emergency response planning is delivered by Paradigm Liaison Services, LLC on behalf of the above sponsoring companies. Visit the National Pipeline Mapping System at <https://www.npms.phmsa.dot.gov> to determine additional companies operating in your area.

Pipeline Purpose and Reliability

- Critical national infrastructure
- Over 2.7 million miles of pipeline provide 65% of our nation's energy
- 20 million barrels of liquid product used daily
- 21 trillion cubic feet of natural gas used annually

Safety Initiatives

- Pipeline location
 - Existing right-of-way (ROW)
- ROW encroachment prevention
 - No permanent structures, trees or deeply rooted plants
- Hazard awareness and prevention methods
- Pipeline maintenance activities
 - Cleaning and inspection of pipeline system

Product Hazards and Characteristics

Petroleum (flow rate can be hundreds of thousands of gallons per hour)

- Flammable range may be found anywhere within the hot zone
- H₂S can be a by-product of crude oil

<u>Type 1 Products</u>	<u>Flash Point</u>	<u>Ignition Temperature</u>
Gasoline	- 45 °F	600 °F
Jet Fuel	100 °F	410 °F
Kerosene	120 °F	425 °F
Diesel Fuel	155 °F	varies
Crude Oil	25 °F	varies

Natural Gas (flow rate can be hundreds of thousands of cubic feet per hour)

- Flammable range may be found anywhere within the hot zone
- Rises and dissipates relatively quickly
- H₂S can be a by-product of natural gas – PPM = PARTS PER MILLION
 - 0.02 PPM Odor threshold
 - 10.0 PPM Eye irritation
 - 100 PPM Headache, dizziness, coughing, vomiting
 - 200-300 PPM Respiratory inflammation within 1 hour of exposure
 - 500-700 PPM Loss of consciousness/possible death in 30-60 min.
 - 700-900 PPM Rapid loss of consciousness; death possible
 - Over 1000 PPM Unconsciousness in seconds; death in minutes
- Incomplete combustion of natural gas may release carbon monoxide
- Storage facilities may be present around populated areas/can be depleted production facilities or underground caverns
- Gas travel may be outside the containment vessel along the natural cavern between the pipe and soil

Highly Volatile Liquids

- Flammable range may be found anywhere within the hot zone
- Products cool rapidly to sub-zero temperatures once outside the containment vessel
- Vapor clouds may be white or clear

<u>Type 3 Products</u>	<u>Flash Point</u>	<u>Ignition Temperature</u>
Propane	- 150 °F	920-1120 °F
Butane	- 60 °F	725-850 °F

Line Pressure Hazards

- Transmission pipelines – steel (*high pressure: average 800-1200psi*)
- Local gas pipeline transmission – steel (*high pressure: average 200-1000psi*)
- Local gas mains and services – steel and/or plastic (*low to medium pressure*)
 - Mains: up to 300psi
 - Service lines: up to regulator
 - Average 30-45psi and below
 - Can be up to 60-100psi in some areas
- At regulator into dwelling: ounces of pressure

Leak Recognition and Response

- Sight, sound, smell – indicators vary depending on product
- Diesel engines – fluctuating RPMs
- Black, dark brown or clear liquids/dirt blowing into air/peculiar odors/dead insects around gas line/dead vegetation
- Rainbow sheen on the water/mud or water bubbling up/frozen area on ground/frozen area around gas meter
- Any sign, gut feeling or hunch should be respected and taken seriously
- Take appropriate safety actions ASAP

High Consequence Area (HCA) Regulation

- Defined by pipeline regulations 192 and 195
- Requires specialized communication and planning between responders and pipeline/gas personnel
- May necessitate detailed information from local response agencies to identify HCAs in area

Emergency Response Basics

- Always follow pipeline/gas company recommendations – pipeline representatives may need escort to incident site
- Advance preparation
 - Get to know your pipeline operators/tour their facilities if possible
 - Participate in their field exercises/request on-site training where available
 - Develop response plans and practice
- Planning partners
 - Pipeline & local gas companies
 - Police – local/state/sheriff
 - Fire companies/HAZMAT/ambulance/hospitals/Red Cross
 - LEPC/EMA/public officials
 - Environmental management/Department of Natural Resources
 - Army Corps of Engineers/other military officials
 - Other utilities
- Risk considerations
 - Type/volume/pressure/location/geography of product
 - Environmental factors – wind, fog, temperature, humidity
 - Other utility emergencies
- Incident response
 - Always approach from upwind/park vehicle a safe distance away/if vehicle stalls – DO NOT attempt to restart
 - Gather information/establish incident command/identify command structure
 - Initiate communications with pipeline/gas company representative ASAP
 - Control/deny entry: vehicle, boat, train, aircraft, foot traffic, media – refer all media questions to pipeline/gas reps
- Extinguish fires only
 - To aid in rescue or evacuation
 - To protect exposures
 - When controllable amounts of vapor or liquid present
- Incident notification – pipeline control center or local gas company number on warning marker
 - In ***Pipeline Emergency Response Planning Information Manual***
 - Emergency contact list in ***Program Guide***
 - Call immediately/provide detailed incident information
- Pipeline security – assist by noting activity on pipeline/gas facilities
 - Report abnormal activities around facilities
 - Suspicious excavation/abandoned vehicles/non-company personnel/non-company vehicles
 - Freshly disturbed soil/perimeter abnormalities

One-Call

- One-Call centers are not responsible for marking lines
- Each state has different One-Call laws. Familiarize yourself with the state you are working in
- Not all states require facility owners to be members of a One-Call
- You may have to contact some facility owners on your own if they are not One-Call members
- In some states, homeowners must call before they dig just like professional excavators

About MLGPA mlgpa.pipelineawareness.org

The Montana Liquid & Gas Pipeline Association (MLGPA) is comprised of pipeline operators in Montana that are dedicated to promoting pipeline safety by providing information for excavators, state residents, businesses, emergency responders, and public officials.

Local Operator Information*

- Operator and/or company name
- Pipeline systems and products
- Location of pipelines
- Pipeline size/operating pressure(s)
- Type of response(s) to a pipeline emergency

*Specific jurisdictional information in handouts tab and on state websites. Information in your materials may not represent all pipeline companies in your area.

Coordinated Response Exercise®

- Learn** specific jurisdictional information in handouts tab. Information in your materials may not represent all pipeline companies in your area.
- Acquaint** you with the operator's ability to respond to a pipeline emergency.
- Identify** the types of pipeline emergencies.
- Plan** how all parties can engage in mutual assistance to minimize hazards to life, property and the environment.

Code of Federal Regulations (CFR): 49 CFR Parts 192 and 195

Roll Call: Law Enforcement, Fire, EMS, Emergency Management, Division of Forest Service, State & Federal Officials, School Officials, PSAP & Pipeline Operators



Block I: Initial Call and Notifications

- **9-1-1 Operators** receive a call about a fire just outside of town. The caller advises they are evacuating cattle and horses from their farm
- A homeowner reports his home appears to be in the path of the fire
- The fire is now reported to be in excess of a half-mile in wide
- The fire department has responded to the incident and is now actively involved in fighting the fire
- Mutual Aid Resources are being actively requested to aid at the scene





Block I: Initial Call and Notifications

Discussion questions for Block I

- Emergency Services Personnel: You have "one minute" to conduct a discussion and write down your top three response priorities for these incidents.
- How will calls from the public potentially impacted by the wildfire be prioritized?
- How will responders (and mutual aid partners) communicate with each other?





Virtual Scenario Manager (VSM™) Map





Block II: On Scene Response

- **Fire units** are having difficulty in controlling the wildfire.
- **Law Enforcement** has been assigned to provide perimeter and access control to the incident
- **Mutual Aid** responders are receiving assignments by radio and cell phone while responding into the area but are not familiar with locations with the jurisdiction. They are requesting the location of the Incident Command Post (ICP)
- **The water supply** is rapidly becoming an issue due to length of time on scene, drought conditions in the area and shuttle / tender rotations
- **The Incident Commander(IC)** makes the decision to order construction of a fire break. A location is determined, and excavators and equipment are rapidly moved into the area. Operations commence and a short time later there is a loud hissing noise, and strong odor of petroleum becomes noticeable
- **Equipment Operators** rapidly determine a pipeline has been struck, and product is escaping from the pipeline





Block II: On Scene Response

Discussion questions for Block II

- What actions to the equipment operators need to take immediately?
- How will the emergency responders and pipeline operators stay in communication?
- Pipeline Operators: With what information is forwarded to you at this time. what action will you and/or your control center (SCADA Center) take in response to this information?
- What resources can you use to find information about the pipeline product, its hazards, and characteristics?





Block III: Governmental Coordination

- **Local pipeline operator** has advised that the process of closing remote valves and "drawing down" the product in the affected area has begun
- **Local business and homeowners** (city and county) have arrived on scene and are requesting to speak with command staff
- **Local television** crews are requesting to speak with command staff and broadcasting live while interviewing the business and homeowners





Block III: Governmental Coordination

Discussion questions for Block III

- Pipeline personnel: Will it be possible to predict when the pipeline will no longer be releasing product?
- Will there be outside agencies (for example State or Federal Government) present at this incident?
- What protective actions should be considered for our community?
- Who will respond to the questions from the business and homeowners?
- How will emergency responders and the pipeline operator coordinate to inform the media?



Exercise Objectives Review

- ✓ Analyzed the elements of the scenario with respect to:
 - ✓ Emergency plans, Response procedures, and tactics
- ✓ Estimated the potential for a leak or release
- ✓ Assessed the appropriate agencies / entities to notify
- ✓ Identified top priorities at the scene
- ✓ Analyzed the need for specialized resources and their location
- ✓ Identified the necessity for emergency responders to shut down the pipeline
- ✓ Evaluated the appropriate protective action for the public in the scenario
- ✓ Evaluated the need for outside assistance



Pipeline System Types

Transmission

Can vary in size and have greater flow and pressure than other types of pipelines. They can transport natural gas or other refined products from a gathering, processing, or storage facility to processing, or additional storage facilities



Distribution

Are unique to natural gas systems. These pipelines are used to deliver product to end users or customers and are mostly found in populated areas





National Emergency Number Association

Pipeline Emergency Operations Standard

NENA's pipeline emergency operations workgroup recommendations

- Awareness of pipelines affecting the 911 service area
- Pipeline leak recognition and initial response actions
- Additional notices to pipeline operators



Initial intake checklist

- Quick reference guide in program materials

Pipeline emergency operations standard/model recommendations

- Access the full report through nena.org

"Actions taken during this time frame significantly impact the effectiveness of the response and are critical to public safety"



National Pipeline Mapping System (NPMS)



MLGPA Overview



CORE Pipeline Mileage Resource by State/County

NATIONAL PIPELINE MAPPING SYSTEM PAGE *Paradigm*

MLGPA
Montana Liquid & Gas Pipeline Association

CORE Product Characteristics

Hazardous Liquids
ER Guide 128 (Pages 192-193)

- Crude oil, jet fuel, gasoline and other refined products
- Liquid in and liquid out of the pipeline**

Highly Volatile Liquids
ER Guide 115 (Pages 166-167)

- Propane, Butane, Ethane and natural gas liquids
- Liquid in and vapor out of the pipeline**

Natural Gas
ER Guide 115 (Pages 166-167)

- Gas in and gas out of the pipeline**
- Odorant added if needed

MLGPA
Montana Liquid & Gas Pipeline Association

CORE Product Characteristic Resources

Mobile Applications
Android & iPhone



ERG 2020
National Library of Medicine
Designated as a
@ERResponse



WISER Response
National Library of Medicine
Designated as a
@NIH



CAMEO Chemicals
National Oceanic and Atmospheric Administration
Designated as a
@NOAA

MLGPA
Montana Liquid & Gas Pipeline Association




Carbon Dioxide (CO₂)

Description and release characteristics

ER Guide 120 (Pages 176-177)

- CO₂ is a colorless, odorless gas in its purest form
- In the pipeline, CO₂ travels in the form of a liquid
- If a release were to occur, it would be as a gas and have a slightly musty odor
- A refrigeration effect would occur with a release producing a vapor cloud (similar to a white smoke cloud) and could be easily dispersed by the wind
- Touching the pipeline or the escaping CO₂ near the leak could cause frostbite
- In its gas form, seeks low-lying areas such as valleys and ditches
- CO₂ is non-flammable and non-toxic, however, in large amounts it could be harmful if inhaled or lead to difficulty in breathing

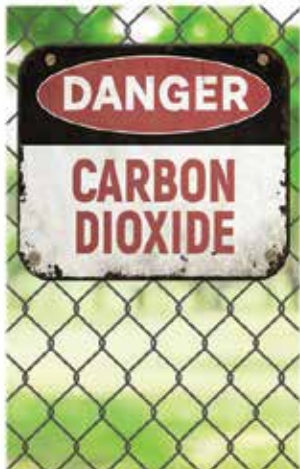



Hydrogen Sulfide (H₂S)

Highly toxic, colorless gas

ER Guide 117 (Pages 170-171)

One of the leading causes of work-related deaths in the petroleum industry and most noticed in crude oil operations

2-5ppm

Prolonged exposure may cause nausea and tearing of the eyes

100-150ppm

Loss of smell (olfactory fatigue or paralysis)

500-700ppm


Staggering, collapse in 5 minutes. Death after 30 to 60 minutes

700-1,000ppm

Rapid unconsciousness, "knockdown" or immediate collapse within 1 to 2 breaths, breathing stops, death within minutes

1,000-2,000ppm

Nearly instant death

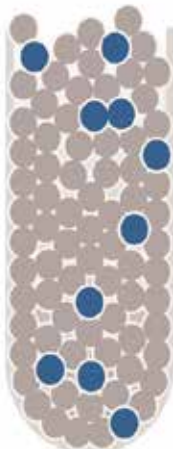

Emergency Response and 811

Derailments, car accidents, excavating/farming mishaps, natural disasters, and wildfires

PHMSA Advisory Bulletin (2012-08)

- Based on National Transportation Board recommendation
- Inform emergency responders about the benefits of 811
- Identify underground utilities in the area
- Notify underground utilities in the area



CORE **Local Distribution Systems**

Caution

- Be aware, not all natural gas leaks are from excavation; unintended leaks from stoves, water, heaters, furnaces, etc. can occur
- When called out on natural gas leak events, use combustible gas indicators
- Mercaptan can be stripped as it travels through soil
- Frost heaves, breaking pipes
- Gas meter breaks due to snow buildup from melting snow falling from roofs

Excess flow valve meter tags

Identification tags [192.381(c)]

- The presence of an excess flow valve on the service lines must be marked with an identification tag. The identification tag will typically be located at the top of the service riser below the meter stop valve






MLGPA
Montana Liquid & Gas Pipeline Association

CORE **Excess Flow Valve (EFV)**

Local Distribution Lines


- Automatic reduction of gas flow should a service line break
- May not completely stop the flow of natural gas
- May not hear a distinct hissing sound
- Migration and ignition sources may still exist
- Always work a coordinated response with your local operator
- Not all service lines have an EFV installed

MLGPA
Montana Liquid & Gas Pipeline Association

CORE **Farm Taps**

- In mainly rural areas, some natural gas pipeline companies may have facilities commonly referred to as "farm tap"
- These natural gas settings are made up of valves, pipes, regulators, relief valves and a meter. It may be located near the home or within the general vicinity
- To report the smell of gas near a farm tap, call 911 and the local gas distribution company from a safe distance



MLGPA
Montana Liquid & Gas Pipeline Association



Training Center

Interaction achieved through face-to-face and virtual programs is invaluable!

In the event others couldn't meet operators virtually, check out Training Center

- Great supplemental training
- Similar to the information in this presentation
- Access to your local pipeline sponsor information
- Review the entire course or specific sections of the course
- Users can pause and continue training at any point in time
- Download the same documents presented in this program
- Certificate of completion provided upon completion of course



Training Center is now live!

trainingcenter.pdlgm.com use code: 2022CORE



State Resources

Visit MLGPA's website at mlgpa.pipelineawareness.org

- Register for MLGPA meetings
- Download MLGPA Member Operator Profiles
- Learn about Montana's One-Call Law
- Learn about Montana's state pipeline regulatory agency
- **Fill out your agency's capability survey annually or if any changes occur throughout the year**



The Gallatin River Ranch Fire Department in Manhattan Montana won a \$2,000 grant from MLGPA for attending a 2021 Spring meeting.

Thank you for attending our MLGPA meeting!



Thank You



POTENTIAL HAZARDS

FIRE OR EXPLOSION

- **HIGHLY FLAMMABLE: Will be easily ignited by heat, sparks or flames.**
- Vapors may form explosive mixtures with air.
- Vapors may travel to source of ignition and flash back.
- Most vapors are heavier than air. They will spread along ground and collect in low or confined areas (sewers, basements, tanks).
- Vapor explosion hazard indoors, outdoors or in sewers.
- Those substances designated with a "P" may polymerize explosively when heated or involved in a fire.
- Runoff to sewer may create fire or explosion hazard.
- Containers may explode when heated.
- Many liquids are lighter than water.
- Substance may be transported hot.
- **If molten aluminum is involved, refer to GUIDE 169.**

HEALTH

- Inhalation or contact with material may irritate or burn skin and eyes.
- Fire may produce irritating, corrosive and/or toxic gases.
- Vapors may cause dizziness or suffocation.
- Runoff from fire control or dilution water may cause pollution.

PUBLIC SAFETY

- **CALL Emergency Response Telephone Number on Shipping Paper first. If Shipping Paper not available appropriate telephone numbers can be found in the Emergency Response Guidebook.**
- As an immediate precautionary measure, isolate spill or leak area for at least 50 meters (150 feet) in all directions.
- Keep unauthorized personnel away.
- Stay upwind.
- Keep out of low areas.
- Ventilate closed spaces before entering.

PROTECTIVE CLOTHING

- Wear positive pressure self-contained breathing apparatus (SCBA).
- Structural firefighters' protective clothing will only provide limited protection.

EVACUATION

Large Spill

- Consider initial downwind evacuation for at least 300 meters (1000 feet).

Fire

- If tank, rail car or tank truck is involved in a fire, ISOLATE for 800 meters (1/2 mile) in all directions; also, consider initial evacuation for 800 meters (1/2 mile) in all directions.

EMERGENCY RESPONSE

FIRE

CAUTION: All these products have a very low flash point: Use of water spray when fighting fire may be inefficient.

CAUTION: For mixtures containing alcohol or polar solvent, alcohol-resistant foam may be more effective.

Small Fire

- Dry chemical, CO₂, water spray or regular foam.

Large Fire

- Water spray, fog or regular foam.

- Use water spray or fog; do not use straight streams.
- Move containers from fire area if you can do it without risk.

Fire involving Tanks or Car/Trailer Loads

- Fight fire from maximum distance or use unmanned hose holders or monitor nozzles.
- Cool containers with flooding quantities of water until well after fire is out.
- Withdraw immediately in case of rising sound from venting safety devices or discoloration of tank.
- ALWAYS stay away from tanks engulfed in fire.
- For massive fire, use unmanned hose holders or monitor nozzles; if this is impossible, withdraw from area and let fire burn.

SPILL OR LEAK

- ELIMINATE all ignition sources (no smoking, flares, sparks or flames in immediate area).
- All equipment used when handling the product must be grounded.
- Do not touch or walk through spilled material.
- Stop leak if you can do it without risk.
- Prevent entry into waterways, sewers, basements or confined areas.
- A vapor suppressing foam may be used to reduce vapors.
- Absorb or cover with dry earth, sand or other non-combustible material and transfer to containers.
- Use clean non-sparking tools to collect absorbed material.

FIRST AID

- Move victim to fresh air.
- Call 911 or emergency medical service.
- Give artificial respiration if victim is not breathing.
- Administer oxygen if breathing is difficult.
- Remove and isolate contaminated clothing and shoes.
- In case of contact with substance, immediately flush skin or eyes with running water for at least 20 minutes.
- Wash skin with soap and water.
- In case of burns, immediately cool affected skin for as long as possible with cold water. Do not remove clothing if adhering to skin.
- Keep victim warm and quiet.
- Ensure that medical personnel are aware of the material(s) involved and take precautions to protect themselves.

PRODUCT: Crude Oil	
DOT GUIDEBOOK ID #: 1267	GUIDE #: 128

PRODUCT: Diesel Fuel	
DOT GUIDEBOOK ID #: 1202	GUIDE #: 128

PRODUCT: Jet Fuel	
DOT GUIDEBOOK ID #: 1863	GUIDE #: 128

PRODUCT: Gasoline	
DOT GUIDEBOOK ID #: 1203	GUIDE #: 128

Refer to the Emergency Response Guidebook for additional products not listed.

POTENTIAL HAZARDS

FIRE OR EXPLOSION

- **EXTREMELY FLAMMABLE..**
- Will be easily ignited by heat, sparks or flames.
- Will form explosive mixtures with air.
- Vapors from liquefied gas are initially heavier than air and spread along ground.
- **CAUTION: Hydrogen (UN1049), Deuterium (UN1957), Hydrogen, refrigerated liquid (UN1966) and Methane (UN1971) are lighter than air and will rise. Hydrogen and Deuterium fires are difficult to detect since they burn with an invisible flame. Use an alternate method of detection (thermal camera, broom handle, etc.)**
- Vapors may travel to source of ignition and flash back.
- Cylinders exposed to fire may vent and release flammable gas through pressure relief devices.
- Containers may explode when heated.
- Ruptured cylinders may rocket.

HEALTH

- Vapors may cause dizziness or asphyxiation without warning.
- Some may be irritating if inhaled at high concentrations.
- Contact with gas or liquefied gas may cause burns, severe injury and/or frostbite.
- Fire may produce irritating and/or toxic gases.

PUBLIC SAFETY

- **CALL Emergency Response Telephone Number on Shipping Paper first. If Shipping Paper not available appropriate telephone numbers can be found in the Emergency Response Guidebook.**
- As an immediate precautionary measure, isolate spill or leak area for at least 100 meters (330 feet) in all directions.
- Keep unauthorized personnel away.
- Stay upwind.
- Many gases are heavier than air and will spread along ground and collect in low

- or confined areas (sewers, basements, tanks).
- Keep out of low areas.

PROTECTIVE CLOTHING

- Wear positive pressure self-contained breathing apparatus (SCBA).
- Structural firefighters' protective clothing will only provide limited protection.
- Always wear thermal protective clothing when handling refrigerated/cryogenic liquids.

EVACUATION

Large Spill

- Consider initial downwind evacuation for at least 800 meters (1/2 mile).

Fire

- If tank, rail car or tank truck is involved in a fire, ISOLATE for 1600 meters (1 mile) in all directions; also, consider initial evacuation for 1600 meters (1 mile) in all directions.

EMERGENCY RESPONSE

FIRE

- **DO NOT EXTINGUISH A LEAKING GAS FIRE UNLESS LEAK CAN BE STOPPED. CAUTION: Hydrogen (UN1049), Deuterium (UN1957) and Hydrogen, refrigerated liquid (UN1966) burn with an invisible flame. Hydrogen and Methane mixture, compressed (UN2034) may burn with an invisible flame.**

Small Fire

- Dry chemical or CO₂.

Large Fire

- Water spray or fog.
- Move containers from fire area if you can do it without risk.

Fire involving Tanks

- Fight fire from maximum distance or use unmanned hose holders or monitor nozzles.
- Cool containers with flooding quantities of water until well after fire is out.
- Do not direct water at source of leak or safety devices; icing may occur.
- Withdraw immediately in case of rising sound from venting safety devices or discoloration of tank.
- ALWAYS stay away from tanks engulfed in fire.
- For massive fire, use unmanned hose holders or monitor nozzles; if this is impossible, withdraw from area and let fire

SPILL OR LEAK

- ELIMINATE all ignition sources (no smoking, flares, sparks or flames in immediate area).
- All equipment used when handling the product must be grounded.
- Do not touch or walk through spilled material.
- Stop leak if you can do it without risk.
- If possible, turn leaking containers so that gas escapes rather than liquid.
- Use water spray to reduce vapors or divert vapor cloud drift. Avoid allowing water runoff to contact spilled material.
- Do not direct water at spill or source of leak.

- Prevent spreading of vapors through sewers, ventilation systems and confined areas.
- Isolate area until gas has dispersed. **CAUTION: When in contact with refrigerated/cryogenic liquids, many materials become brittle and are likely to break without warning.**

FIRST AID

- Move victim to fresh air.
- Call 911 or emergency medical service.
- Give artificial respiration if victim is not breathing.
- Administer oxygen if breathing is difficult.
- Remove and isolate contaminated clothing and shoes.
- Clothing frozen to the skin should be thawed before being removed.
- In case of contact with liquefied gas, thaw frosted parts with lukewarm water.
- In case of burns, immediately cool affected skin for as long as possible with cold water. Do not remove clothing if adhering to skin.
- Keep victim warm and quiet.
- Ensure that medical personnel are aware of the material(s) involved and take precautions to protect themselves.

PRODUCT: Propane	
DOT GUIDEBOOK ID #: 1968	GUIDE #: 115

PRODUCT: Butane	
DOT GUIDEBOOK ID #: 1075	GUIDE #: 115

PRODUCT: Ethane	
DOT GUIDEBOOK ID #: 1035	GUIDE #: 115

PRODUCT: Propylene	
DOT GUIDEBOOK ID #: 1075/1077	GUIDE #: 115

PRODUCT: Natural Gas Liquids	
DOT GUIDEBOOK ID #: 1972	GUIDE #: 115

Refer to the Emergency Response Guidebook for additional products not listed.

POTENTIAL HAZARDS

FIRE OR EXPLOSION

- **EXTREMELY FLAMMABLE.**
- Will be easily ignited by heat, sparks or flames.
- Will form explosive mixtures with air.
- Vapors from liquefied gas are initially heavier than air and spread along ground.
- **CAUTION: Hydrogen (UN1049), Deuterium (UN1957), Hydrogen, refrigerated liquid (UN1966) and Methane (UN1971) are lighter than air and will rise. Hydrogen and Deuterium fires are difficult to detect since they burn with an invisible flame. Use an alternate method of detection (thermal camera, broom handle, etc.)**
- Vapors may travel to source of ignition and flash back.
- Cylinders exposed to fire may vent and release flammable gas through pressure relief devices.
- Containers may explode when heated.
- Ruptured cylinders may rocket.

HEALTH

- Vapors may cause dizziness or asphyxiation without warning.
- Some may be irritating if inhaled at high concentrations.
- Contact with gas or liquefied gas may cause burns, severe injury and/or frostbite.
- Fire may produce irritating and/or toxic gases.

PUBLIC SAFETY

- **CALL Emergency Response Telephone Number on Shipping Paper first. If Shipping Paper not available appropriate telephone numbers can be found in the Emergency Response Guidebook.**
- As an immediate precautionary measure, isolate spill or leak area for at least 100 meters (330 feet) in all directions.
- Keep unauthorized personnel away.
- Stay upwind.
- Many gases are heavier than air and will spread along ground and collect in low

- or confined areas (sewers, basements, tanks).
- Keep out of low areas.

PROTECTIVE CLOTHING

- Wear positive pressure self-contained breathing apparatus (SCBA).
- Structural firefighters' protective clothing will only provide limited protection.
- Always wear thermal protective clothing when handling refrigerated/cryogenic liquids.

EVACUATION

Large Spill

- Consider initial downwind evacuation for at least 800 meters (1/2 mile).

Fire

- If tank, rail car or tank truck is involved in a fire, ISOLATE for 1600 meters (1 mile) in all directions; also, consider initial evacuation for 1600 meters (1 mile) in all directions.

EMERGENCY RESPONSE

FIRE

- **DO NOT EXTINGUISH A LEAKING GAS FIRE UNLESS LEAK CAN BE STOPPED. CAUTION: Hydrogen (UN1049), Deuterium (UN1957) and Hydrogen, refrigerated liquid (UN1966) burn with an invisible flame. Hydrogen and Methane mixture, compressed (UN2034) may burn with an invisible flame.**

Small Fire

- Dry chemical or CO₂.

Large Fire

- Water spray or fog.
- Move containers from fire area if you can do it without risk.

Fire involving Tanks

- Fight fire from maximum distance or use unmanned hose holders or monitor nozzles.
- Cool containers with flooding quantities of water until well after fire is out.
- Do not direct water at source of leak or safety devices; icing may occur.
- Withdraw immediately in case of rising sound from venting safety devices or discoloration of tank.
- ALWAYS stay away from tanks engulfed in fire.
- For massive fire, use unmanned hose holders or monitor nozzles; if this is impossible, withdraw from area and let fire burn.

SPILL OR LEAK

- ELIMINATE all ignition sources (no smoking, flares, sparks or flames in immediate area).
- All equipment used when handling the product must be grounded.
- Do not touch or walk through spilled material.
- Stop leak if you can do it without risk.
- If possible, turn leaking containers so that gas escapes rather than liquid.
- Use water spray to reduce vapors or divert vapor cloud drift. Avoid allowing water runoff to contact spilled material.
- Do not direct water at spill or source of leak.
- Prevent spreading of vapors through sewers, ventilation systems and confined areas.

- Isolate area until gas has dispersed.
- **CAUTION: When in contact with refrigerated/cryogenic liquids, many materials become brittle and are likely to break without warning.**

FIRST AID

- Move victim to fresh air.
- Call 911 or emergency medical service.
- Give artificial respiration if victim is not breathing.
- Administer oxygen if breathing is difficult.
- Remove and isolate contaminated clothing and shoes.
- Clothing frozen to the skin should be thawed before being removed.
- In case of contact with liquefied gas, thaw frosted parts with lukewarm water.
- In case of burns, immediately cool affected skin for as long as possible with cold water. Do not remove clothing if adhering to skin.
- Keep victim warm and quiet.
- Ensure that medical personnel are aware of the material(s) involved and take precautions to protect themselves.

DOT GUIDEBOOK ID #:	GUIDE #:
1971	115

CHEMICAL NAMES:

- Natural Gas
- Methane
- Marsh Gas
- Well Head Gas
- Fuel Gas
- Lease Gas
- Sour Gas*


CHEMICAL FAMILY:

Petroleum Hydrocarbon Mix: Aliphatic Hydrocarbons (Alkanes), Aromatic Hydrocarbons, Inorganic Compounds

COMPONENTS:

Methane, Iso-Hexane, Ethane, Heptanes, Propane, Hydrogen Sulfide*, (In "Sour" Gas), Iso-Butane, Carbon, Dioxide, n-Butane, Nitrogen, Pentane Benzene, Hexane, Octanes

Product INFORMATION

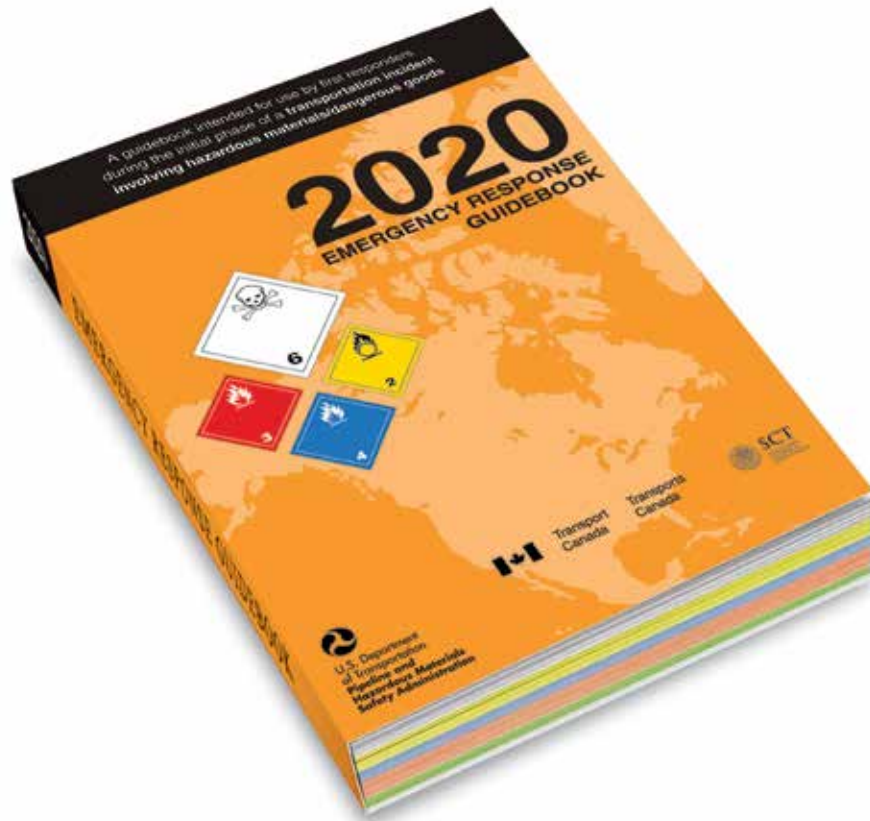

The Emergency Response Guidebook is available at:
<https://www.phmsa.dot.gov/sites/phmsa.dot.gov/files/2021-01/ERG2020-WEB.pdf>



This app is only available on the App Store for iOS devices.



820 Gessner Rd. Suite 1450
Houston, TX 77024
Phone: (346) 249-3200
Website: www.bayoumidstream.com

WHO IS BAYOU MIDSTREAM BAKKEN

Bayou Midstream Bakken, LLC is a wholly owned subsidiary of Bayou Midstream, LLC. We operate a crude gathering system with just under 18 miles of low-pressure crude 6", 5", 4" pipe. Our pipeline system is 100% within Richland County Montana.

If you observe any unusual or suspicious activity near our pipeline facilities or in the unlikely event an emergency occurs, please call us at any time using one of the numbers listed in this document.

More information on Bayou Midstream Bakken can be found at: www.bayoumidstream.com.

WHAT ARE THE SIGNS OF A CRUDE OIL PIPELINE LEAK?

- The pooling of liquid on the ground
- An odor like petroleum liquids or gasoline
- A sheen on the surface of water
- An area of dead vegetation

WHAT SHOULD I DO IF I SUSPECT A PIPELINE LEAK?

Your personal safety should be your first concern:

- Evacuate the area and prevent anyone from entering
- Abandon any equipment being used near the area
- Avoid any open flames
- Avoid introducing any sources of ignition to the area (such as cell phones, pagers, 2-way radios)
- Do not start/turn off motor vehicles/ electrical equipment
- Call 911 or contact local fire or law enforcement
- Notify the pipeline company
- Do not attempt to extinguish a crude oil fueled fire
- Do not attempt to operate any pipeline valves

PIPELINE SAFETY

Many pipeline releases are caused by damage from others digging near the pipeline. We watch for unauthorized digging, but we request your help to notify us.

ALWAYS CALL 811 BEFORE YOU DIG!

PIPELINE LOCATION AND MARKERS

Pipeline markers are used to indicate the approximate location of a crude oil pipeline and to provide contact information. Markers should never be removed or relocated by anyone other than a pipeline operator.



**EMERGENCY CONTACT:
1-888-489-2747**

PRODUCTS/DOT GUIDEBOOK ID#/GUIDE#:		
Crude Oil	1267	128

MONTANA COUNTIES OF OPERATION:


Richland

Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.

You can also find out where other companies' pipelines are in your area by going to the National Pipeline Mapping System website at www.npms.phmsa.dot.gov.

COMMITMENT TO SAFETY, HEALTH, & ENVIRONMENT

Bayou Midstream Bakken is fully committed to the safety and health of our employees and neighbors. Additionally, the environment we work and operate in is extremely important to us. We view ourselves as a steward of the land moving your energy by means of the safest way possible.

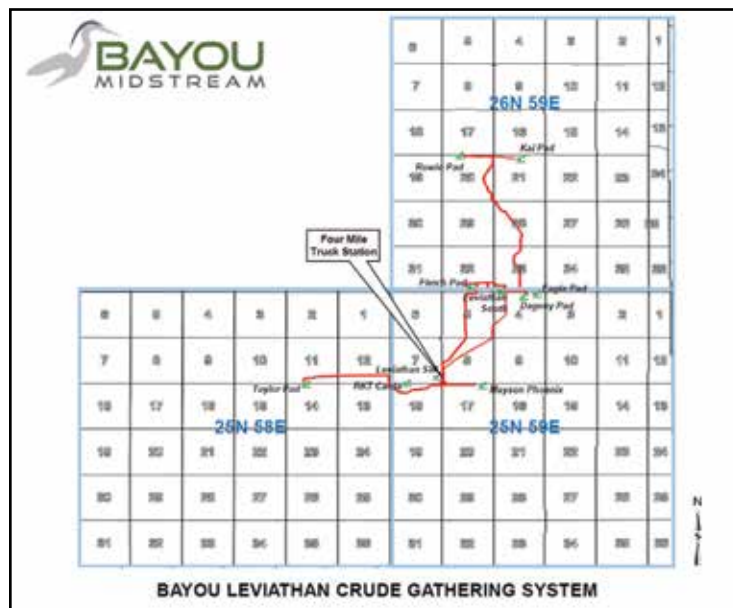



Bridger Pipeline LLC owns and operates the Poplar System and Four Bears System in eastern Montana. Poplar is a 10" and 12" line that has the ability to gather crude oil at Poplar, Fisher, Richey and Glendive for delivery to Butte Pipeline at Baker for further transportation to Guernsey, Wyoming. Bridger's Four Bears Pipeline is a 10" line that transports crude from various pipelines in North Dakota to Butte Pipeline at Baker, Montana for further transportation to Guernsey, Wyoming. Butte Pipeline operated by Bridger Pipeline LLC is a 16", 323 mile crude oil pipeline system from Baker,

Montana to Ft. Laramie and Guernsey, Wyoming. The system gathers crude from the Cedar Creek Anticline area near Baker and transports crude via other incoming pipelines such as crude from the Williston Basin and Eastern Montana. Belle Fourche Pipeline Company is a liquids pipeline operator that gathers and transports crude oil in the Williston Basin of western North Dakota and the Powder River Basin of Wyoming. Belle Fourche Pipeline Company, Bridger Pipeline LLC, and Butte Pipeline Company are a system of pipelines operating over 3,400 miles of pipeline. Safety is of utmost priority


EMERGENCY CONTACT:
1-866-305-3741

PRODUCTS/DOT GUIDEBOOK ID#/GUIDE#:		
Crude Oil	1268	127

MONTANA COUNTIES OF OPERATION:

Carter	Richland
Dawson	Roosevelt
Fallon	Sheridan
Powder River	Wibaux
Prairie	

Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.

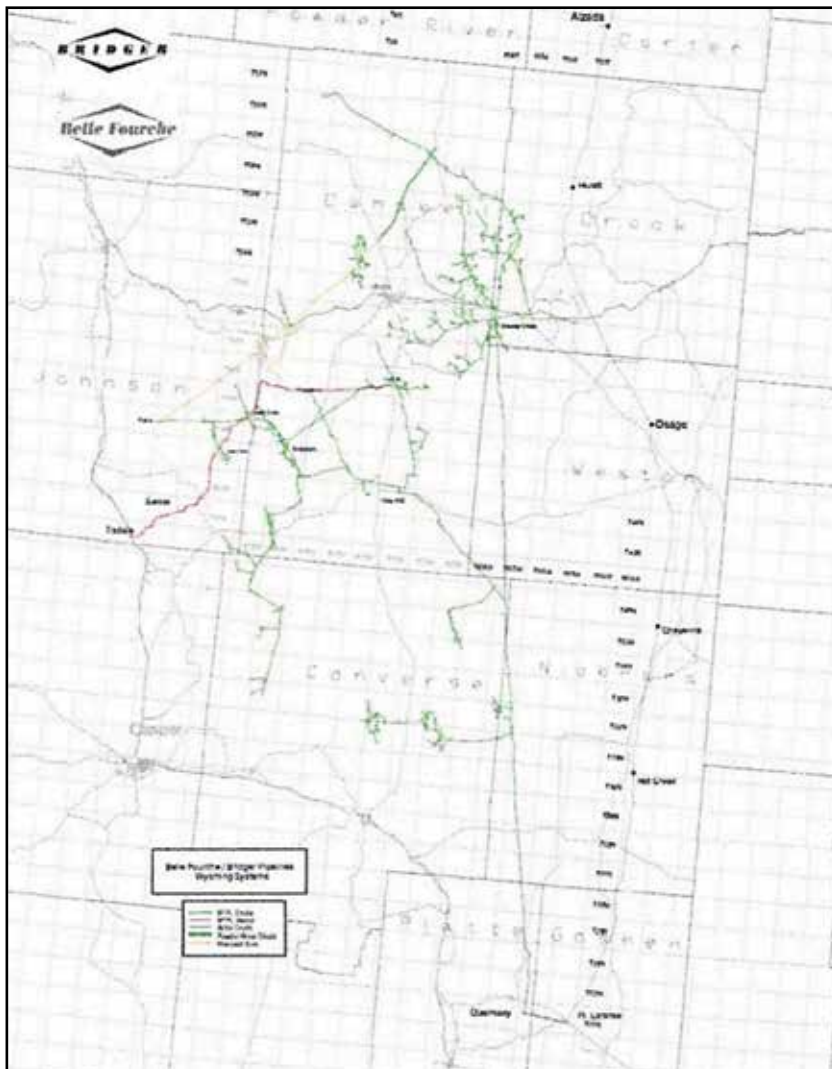

to Belle Fourche Pipeline Company, Bridger Pipeline LLC, and Butte Pipeline Company. An excellent pipeline safety record is achieved through employment of highly qualified staff that is thoroughly trained in a variety of pipeline operation, maintenance and safety related issues. In the event of an emergency, our staff are readily trained, prepared and equipped to respond to any emergency in a safe and environmentally responsible manner.

Headquarters:

Belle Fourche Pipeline Company
Bridger Pipeline LLC
Butte Pipeline Company
PO Drawer 2360
455 North Poplar
Casper, WY 82601
Phone: 800-442-2966
Website: www.truecos.com



Headquarters & Local Office
 1900 10th Street N.E.
 Great Falls, MT 59404
 Phone: 406-761-4100



Montana Refining Company, Inc. operates a 2.6 mile petroleum pipeline (Crude Oil) in your area as shown on the map below.

A pipeline problem or emergency may be indicated by any of the following conditions:

- Pool of liquid on the ground
- Discolored or dying pipeline covering vegetation
- Unusual odor
- Fire at or near exposed pipeline or apparently emanating from the ground

If you notice any of these conditions report it immediately to Montana Refining Company, Inc.

COMMITMENT TO SAFETY, HEALTH, & ENVIRONMENT

CMR Pipeline is committed to the safe, environmentally sound, and efficient operation of our pipelines near your residence or place of business. In the event of an emergency, CMR Pipeline will send personnel to the site to help public safety officials. We will take all the necessary steps to minimize the danger, such as stopping pumps and closing valves. Only authorized CMR employees are to operate pipeline safety equipment. Improper operation of safety equipment could cause more damage and even bodily injury. For more information on our pipeline safety program, contact CMR at 1-406-761-4100.

EMERGENCY CONTACT:
1-406-761-4100

PRODUCTS/DOT GUIDEBOOK ID#/GUIDE#:		
Crude Oil	1268	127

MONTANA COUNTIES OF OPERATION:

Cascade


Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.

CMR's Non-Emergency contact name and number:

Shannon Chouinard – Env. Specialist
 Joe Dauner – Env. Manager
 Calumet Montana Refining, LLC
 1-406-761-4100
 Montana Utility Call Center
 1-800-424-5555



**Know what's below.
 Call before you dig.**

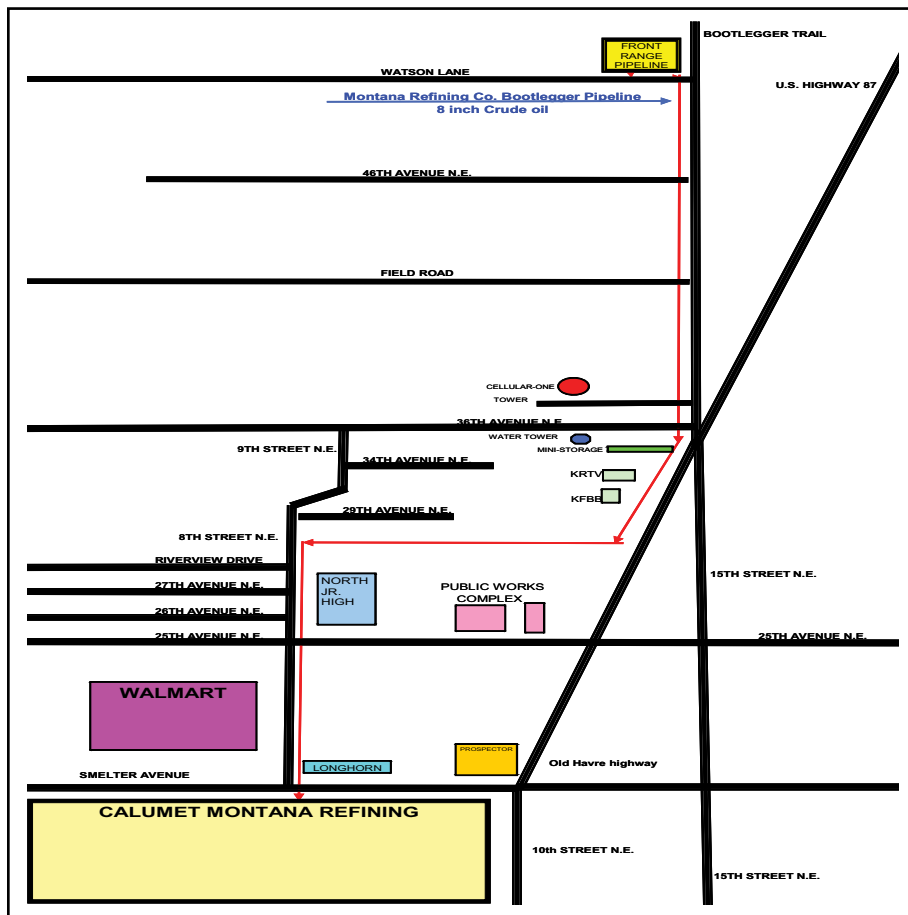



Cenex Pipeline, LLC. a whole-owned subsidiary of CHS Inc.

PO Box 909
 803 Highway 212
 Laurel, MT 59044
 Non-Emergency Phone: (855) 4-CHSPIPE
 Email: publicawareness@chsinc.com
 Website: www.chsinc.com/pipelines

CENEX PIPELINE, LLC.

Cenex Pipeline, LLC. (CPL) is owned and operated by CHS Inc. CPL transports an average of 43,000 barrels of refined products a day. It spans more than 724 miles across Montana and North Dakota. Our pipeline size varies from 8-10 inches and MOP is up to 1440. CPL transports refined petroleum products from refineries in the Laurel area to terminals and tank farms in Billings, MT; Glendive, MT; Minot, ND; Grand Forks, ND; Fargo, ND; Chippewa Falls, WI; and McFarland, WI.

CPL is continually working to improve its ability to serve its cooperative owners. To ensure a reliable supply of gasoline and diesel fuel for our farmer-owners and customers. We are committed to the communities we serve as we provide about 40% of the fuel used in North Dakota. CHS Inc. pays roughly 4.65 million in property taxes per year which supports local education, road infrastructure, city & county services, such as public transport and mental health services.



**EMERGENCY CONTACT:
 1-800-421-4122**

PRODUCTS/DOT GUIDEBOOK ID#/GUIDE#:		
Gasoline	1203	128
Diesel Fuel	1202/1993	128

**MONTANA
 COUNTIES OF OPERATION:**

Big Horn	Roosevelt
Custer	Rosebud
Dawson	Treasure
Prairie	Yellowstone
Richland	

Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.

COMMITMENT TO SAFETY, HEALTH, AND ENVIRONMENT

CPL is committed to operating our pipelines safely and protecting our employees, communities and our environment. Part of this is achieved through public education and we believe furthering the general awareness of the public and being transparent to the issues surrounding our pipeline operations creates a safer system. This has included the development, implementation, and management of a Public Awareness Program (PAP). Through these efforts, CPL will enhance public safety, and reduce the risk of third-party damage to the pipeline system. The company and its management will provide the needed support, resources, and funding required to accomplish these goals. CPL's highest priority is the transportation of products throughout its system in a reliable, safe and compliant manner. CPL is dedicated to these goals and follows all applicable pipeline rules and regulations. Ensuring the mechanical integrity of its pipeline system is an important ingredient toward accomplishing our goals. To this end, CPL has created and implemented a comprehensive pipeline Integrity Management Plan (IMP). For additional information, contact us via email, phone or visit our web site as listed above.

CENEX PIPELINE, LLC PIPELINE MARKER TYPES



Pipeline Markers always tell you three critical pieces of information:

1. The product being transported.
2. Name of the company.
3. The 24/7 emergency number.

If an emergency situation should arise or you see something suspicious look for pipeline markers in the area. Call 911 first, then emergency number on the nearest pipeline marker.





EMERGENCY ACTION PROCEDURES FOR PUBLIC SAFETY OFFICIALS

If you are a public safety official, use all applicable training you have received in taking the steps necessary to safeguard the public in the event of a pipeline emergency. The following are some guidelines to keep in mind:

- Secure the area around the leak to a safe distance. This could include evacuating people from homes, businesses, schools and other locations, erecting barricades, controlling access to the emergency site, and similar precautions.
- If the pipeline leak is not burning, take steps to prevent ignition. This could include prohibiting smoking, rerouting traffic, and shutting of the electricity and residential gas supply.
- If the pipeline leak is burning, take steps to prevent secondary fires but DO NOT attempt to extinguish a pipeline fire unless asked to do so by pipeline company personnel.
- Contact the pipeline company as quickly as possible. Pipeline marker signs show the pipeline company's name and emergency telephone.

INCIDENT COMMAND SYSTEM

Kinder Morgan utilizes an expandable Incident Command System. Depending upon the size and complexity of an incident, additional Company or contract personnel may be added as needed. Additional federal, state or local agencies may be integrated into the Incident Command System by utilizing a Unified Command Structure.

SPILL RESPONSE EQUIPMENT

Kinder Morgan maintains emergency response trailers and equipment at strategically located facilities. Trailers contain spill boom (of various types, sizes and lengths as needed in different areas), sorbent materials, boats, motors, hand tools, power tools, pumps, hoses, personal protective equipment, first aid and miscellaneous supplies.

KINDER MORGAN EMERGENCY RESPONSE CAPABILITIES

COMMITMENT

Kinder Morgan Pipeline Company is committed to the protection of the public and the environment through the safe operation and maintenance of its pipeline systems. Kinder Morgan's qualified personnel are trained in emergency response activities and regularly participate in drills and exercises reflecting various types of response levels, emergency scenarios, topographic terrain and environmental sensitivities.

Kinder Morgan has committed the necessary resources to fully prepare and implement its emergency response plans and has obtained through contract the necessary private personnel and equipment to respond, to the maximum extent practicable, to a "worst case" discharge or substantial threat of such a discharge.

COMMUNICATIONS

Kinder Morgan utilizes its 24-hour Pipeline Control Center as a hub of communications in emergency response situations. The Control Center has a vast catalog of resources and capabilities. On-site communications are conducted using cellular telephones, 6GigHz analog 120 channel microwave radios (in Company vehicles), portable Motorola Radios and/or land-line telephone systems from Company facilities and offices. Response trailers are maintained at Kinder Morgan facilities in various locations. OIL SPILL CONTRACTORS Certified Oil Spill Response Organizations (OSROs) under contract by Kinder Morgan are Clean Harbors and Conestoga-Rovers and Associates. These OSROs can be relied upon for an appropriate level of response with spill response equipment and trained personnel.

EMERGENCY CONTACT:
1-877-712-2288

PRODUCTS/DOT GUIDEBOOK ID#/GUIDE#:		
Natural Gas	1971	115

MONTANA COUNTIES OF OPERATION:

Carbon

Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.

For more information about Kinder Morgan or information regarding Kinder Morgan's emergency response plans and procedures, please contact:

Kinder Morgan
1001 Louisiana St., Suite 1000
Houston, TX 77002

Non-Emergency number 800-276-9927
<http://PA-InfoRequest.KinderMorgan.com>





Energy West, Incorporated distributes and sells natural gas to end use residential, commercial and industrial customers. It distribute natural gas to approximately 32,000 customers and propane to approximately 30 customers through regulated utilities operating in Montana. The company's Montana public utility was originally incorporated in 1909 and is headquartered in Great Falls, Montana.

COMMITMENT TO SAFETY, HEALTH, & ENVIRONMENT

In the unlikely event of a pipeline emergency, our employees are prepared to respond in coordination with local policy and fire departments and other emergency responders. We meet with these responders to discuss our emergence response plans and the plans are designed to protect people, the environment and property. The safety of people and the environment is the company's first priority and a key part of achieving the company's vision.



Headquarters:

Energy West
1 First Avenue South
Great Falls, MT 59403
(406) 791-7500

Energy West Montana

904 9th Street North
Great Falls, MT 59401
Above address is for distribution lines in Cascade County. Natural Gas and Propane. (406) 791-7500

Energy West West Yellowstone

PO Box 582
145 Geyser Street
West Yellowstone, MT 59758
Above address is for distribution lines in Galatin County.
Natural Gas. 1-406-646-4437

Cut Bank Gas Company

403 East Main Street
Cut Bank, MT. 59427
Above address is for distribution lines in Glacier County.
Natural Gas. 1-406-873-5533

EMERGENCY CONTACT:

1-800-570-5688
1-406-791-7500 - Cascade
1-406-646-4437 - Gallatin
1-406-873-5533 - Glacier

PRODUCTS/DOT GUIDEBOOK ID#/GUIDE#:

Natural Gas	1971	115
Propane	1978/1075	115

MONTANA COUNTIES OF OPERATION:

Cascade Glacier
Gallatin

Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.



5400 Westheimer Court
 Houston, TX 77056
 Public Awareness: 1-888-293-7867
 Email: USpublicawareness@enbridge.com
 Website: www.enbridge.com

Life takes energy: to heat our homes, to feed our families, to fuel our vehicles. Enbridge connects people to the energy they need to help fuel their quality of life.

In the United States alone, more than two million miles of pipelines deliver petroleum and natural gas products. Every year, Enbridge invests in the latest technology and training to meet the high environmental and safety standards our neighbors expect, and to keep pipelines the safest, most efficient and most reliable way to move energy resources.

Our safety measures

Safety is, and always will be, our number one priority. Our team devotes hundreds of thousands of hours every year to keep our systems running smoothly and without incident. We invest heavily in safety measures including:

- High-quality pipeline material and protective coating
- Pressure tests on new and existing pipelines
- Inspection and preventative maintenance programs
- Round-the-clock monitoring for pipelines and facilities
- Aerial and ground patrols along the pipeline right-of-way
- Automatic shut-off and remote control valves
- Emergency response training and drills for employees and local emergency responders
- Inspection and preventative maintenance programs

What if there is an emergency?

Enbridge facilities are designed to be quickly isolated with block valves for rapid containment in the event of an emergency. We have pre-arranged plans with local emergency personnel and periodically conduct emergency drills with these groups.

Emergency responder education program

Enbridge offers a free online education program to provide public safety and local public officials with the information needed to safely and effectively respond to a pipeline emergency. This program focuses on information specific to the disciplines of firefighting, law enforcement, 9-1-1 dispatch, emergency medical services, emergency management and local government. Additionally, course completion may count for state-level continuing education (CE) credits. Register for the training at www.mypipelinetraining.com.

Call or click before you dig

811 and **ClickBeforeYouDig.com** are free services designed to keep you safe when digging. Calling or clicking is always the safest option anytime you are moving dirt. At least two to three business days before your project (depending on state law), simply call 811 or visit www.ClickBeforeYouDig.com with important details about your work, including:

- The type of work you'll be doing and a description of the area
- The date and time your project will begin
- Your worksite's address, the road on which it's located and the nearest intersection
- Driving directions or GPS coordinates
- Within two to three business days, professional locators will mark underground utility lines—including pipelines (marked with yellow flags or paint)—so you can work around them, saving yourself from possible injury or property damage.

EMERGENCY CONTACT:

1-800-858-5253

PRODUCTS/DOT GUIDEBOOK ID#/GUIDE#:

Crude Oil 1267 128

MONTANA COUNTIES OF OPERATION:

Carbon	Judith Basin
Chouteau	Sheridan
Fergus	Stillwater
Golden Valley	Wheatland
Hill	

Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.

Pipeline location and markers

All pipeline markers provide the name of the pipeline operator, product being transported and a telephone number for reporting pipeline emergencies. These markers should never be used as a reference for a pipeline's exact location.

You can also find out where other companies' pipelines are in your area by going to the National Pipeline Mapping System website at <https://www.npms.phmsa.dot.gov>.





ABOUT EXXONMOBIL PIPELINE COMPANY

ExxonMobil Pipeline Company (EMPCo) is committed to the safe, efficient and environmentally responsible transportation of energy. The company transports crude oil, refined products, liquefied petroleum gases, natural gas liquids, chemical feedstocks and other materials through more than 4,000 miles of pipeline and facilities in 10 states.

PIPELINE INTEGRITY

We follow a comprehensive integrity management system that requires compliance with all applicable laws and regulations and systematic identification and management of safety, health and environmental risks. We regularly test and maintain our pipelines using cleaning devices, diagnostic tools and cathodic protection to detect and prevent corrosion.

We patrol our pipeline routes using ground and air surveillance and closely monitor our operations through a 24-hour control center. Our control center includes sophisticated computers, alarms and other technologies used to monitor and control our pipeline systems and enables us to implement immediate protective measures should a leak be detected.

HOW YOU CAN HELP KEEP PIPELINE SAFE

- Keep the rights of way near or on your property clear of any kind of obstruction. Property owners should not dig, build, store or place or plant anything on the right of way. Pipeline rights of way must be kept free of structures and other obstructions in order to provide us access to the pipeline for maintenance, assessments, as well as in the event of an emergency.

- Before beginning work on any excavation project, especially those near a pipeline (marked by a pipeline marker), call 811 -- the national one-call number -- or your state's One Call System. Every digging job requires a call -- even small projects like planting trees or shrubs. It is for your safety and that of the public. It is a free call-- and it is the law! You can find out more about pipelines operating in your area from the National Pipeline Mapping System - www.npms.phmsa.dot.gov.

SIGNS OF A LEAK

Petroleum pipelines carry both gaseous and liquid materials that can burn or explode if exposed to a spark or other ignition source. Many liquids form gaseous vapor clouds when released into the air. Pipelines may contain colorless and odorless products. Some pipeline gases are lighter than air and will rise. Others are heavier than air and will stay near the ground, collecting in low spots. Any pipeline leak is potentially dangerous.

Markers that indicate the location of pipelines may include warning signs, aerial patrol markers, casing vents and painted metal, and wooden or plastic posts.

By sight:

- Liquid or frozen ground near a pipeline right-of-way
- Water bubbling or being blown into the air
- Discolored or abnormally dry soil
- Rainbow or oily sheen on water surfaces
- A fire or explosion
- Dense white cloud or fog
- Discolored vegetation

EMERGENCY CONTACT: 1-800-537-5200

PRODUCTS/DOT GUIDEBOOK ID#/GUIDE#:		
Crude Oil	1267	128

MONTANA COUNTIES OF OPERATION:

Carbon Yellowstone

Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.

By sound:

- Unusual noises, such as hissing or roaring

By smell:

- Unusual petroleum, chemical or sulfuric "rotten egg" smell

IF YOU SUSPECT A PIPELINE IS LEAKING

- Immediately leave the area and move upwind from the suspected release.
- Do not touch, breathe or make contact with the suspect liquid.
- Do not use a lighter or match, start an engine, use a mobile phone or light switch, or do anything that might create a spark.
- Do not drive into a release or its associated vapors.
- From a safe location: First call 911.
- Then call ExxonMobil Pipeline's emergency number: 1-800-537-5200.
- Do not attempt to operate any pipeline valves or other equipment, as this could make the situation worse.

EMERGENCY RESPONSE

At EMPCo, we work hard to prevent a pipeline incident, but in the unlikely event of a pipeline emergency, we are prepared to respond quickly. We regularly communicate, plan and drill

with your local emergency personnel, such as fire and police departments, to ensure our response to an incident is well-coordinated and effective. To request a copy of an emergency response plan, please contact us at public.awareness@exxonmobil.com.

CONTACTS

Contact list subject to change. In case of emergency or suspected pipeline incident, always call the 24-Hour Emergency Hotline: (800) 537-5200 and 911

Operations Control Center

22777 Springwoods Village Parkway
Spring, TX 77389
24 Hour Emergency Hotline:
(800) 537-5200
Non-Emergency Hotline:
(888) 804-4788

Public & Stakeholder Engagement Advisor

Walter Cayce
Phone: (888) 804-4788
Email:
public.awareness@exxonmobil.com

Local Office

ExxonMobil Pipeline Company 607
ExxonMobil Refinery
Road Billings, MT 59101
James Vokral
(406) 672-8457
Tyler Wattles
(406) 545-1531



EXAMPLES OF PIPELINE MARKERS



Headquarters:
 P.O. Box 909
 803 Highway 212 South
 Laurel, MT 59044
Toll Free Non-Emergency: 1-888-4-CHSPIPE
Email: publicawareness@chsinc.com
Website: www.chsinc.com/pipelines

Front Range Pipeline, LLC (FRPL) is headquartered in Laurel, Mont., and is owned by CHS, Inc. an American, farmer-owned cooperative. FRPL transport's more than 65,000 barrels crude oil from the Canadian Border to refineries in Great Falls, Laurel and Billings, MT area. FRPL moves product across 389 miles of pipeline in MT, with storage facilities in Santa Rita, Cutbank, Buffalo, Laurel and Billings. Our pipeline varies in size from 6-16 inches with MOP of up to 1480. We are only located in Montana and on average spend over \$4,000,000 dollars a year in State property taxes. These taxes go to support our schools, roads, and local community services.

COMMITMENT TO SAFETY, HEALTH, & ENVIRONMENT

As a large and diverse business serving many stakeholders, including customers, employees, communities and owners, CHS maintains the highest commitment to "doing the right thing." That means meeting regulatory compliance in our daily business

operations, our financial reporting and our environmental, health and safety programs. As subsidiaries of CHS, Cenex Pipeline, LLC and Front Range Pipeline, LLC. are fully committed to operating a safe and reliable hazardous liquid pipeline system in Montana and North Dakota.

EMERGENCY CONTACT:
1-800-421-4122

PRODUCTS/DOT GUIDEBOOK ID#/GUIDE#:
 Crude Oil 1267/3494 128/131

MONTANA COUNTIES OF OPERATION:

Cascade	Stillwater
Fergus	Toole
Glacier	Teton
Golden Valley	Wheatland
Judith Basin	Yellowstone
Pondera	

Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.

FRONT RANGE PIPELINE, LLC



© 2018 CHS Inc. Front Range Pipeline, LLC. is a whole-owned subsidiary of CHS Inc.



PRODUCT	LEAK TYPE	VAPORS
HAZARDOUS LIQUIDS [PREDOMINANTLY CRUDE OIL, BUT MAY ALSO INCLUDE DIESEL FUEL, JET FUEL, GASOLINE, AND OTHER REFINED PRODUCTS]	Liquid	Initially heavier than air and spread along ground and collect in low or confined areas. Vapors may travel to source of ignition and flash back. Explosion hazards indoors, outdoors or in sewers.
HEALTH HAZARDS	Inhalation or contact with material may irritate or burn skin and eyes. Fire may produce irritating, corrosive and/or toxic gases. Vapors may cause dizziness or suffocation. Runoff from fire control or dilution water may cause pollution.	





Montana Natural Gas Fact Sheet

OUR SERVICE

Have Pipeline provides transportation of natural gas from over 1000 wells in a safe and dependable manner. We operate one of Montana's largest natural gas fields though 1000 miles of pipeline. Gas is compressed at 11 different compressor stations in 3 counties located in north central Montana. Combined, the stations have a total of 25,000 horsepower.

Have Pipeline Company LLC is a partnership owned by NorthWestern Energy of Oklahoma City.

OUR COMMITMENT TO SAFETY, HEALTH AND ENVIRONMENT

NorthWestern Energy is committed to public safety, protection of the environment, and operation of its facilities in compliance with all applicable rules and regulations. NorthWestern Energy adheres to the regulatory oversight of the Office of Pipeline Safety in the U.S. Department of Transportation. The company is proud of its safety record and follows many regulations and procedures to monitor and ensure the integrity of its pipelines.

EMERGENCY CONTACT:
1-406-357-2233

PRODUCTS/DOT GUIDEBOOK ID#/GUIDE#:
Natural Gas 1971 115

MONTANA COUNTIES OF OPERATION:

Blaine Chouteau

Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.

EMERGENCY CONTACT:
1-406-357-2233


We're on call 24 hours a day to respond to your emergencies. Make sure you place your call from a telephone located far enough away from the danger area. Be sure to tell us the following information:

- The location including the street address and city where the incident is taking place
- Details of the incident
- Whether gas is leaking or burning inside or outside
- Details of any evacuations (numbers of people affected and the area affected)
- Your name and organization

EMERGENCY RESPONSE PLANS

For additional resources specifically concerning natural gas training and/or review of NorthWestern Energy's emergency response plan contact:

Local Office:
Have Pipeline Company
PO Box 2606
14815 Clear Creek Road
Have, MT 59501
406-357-2233

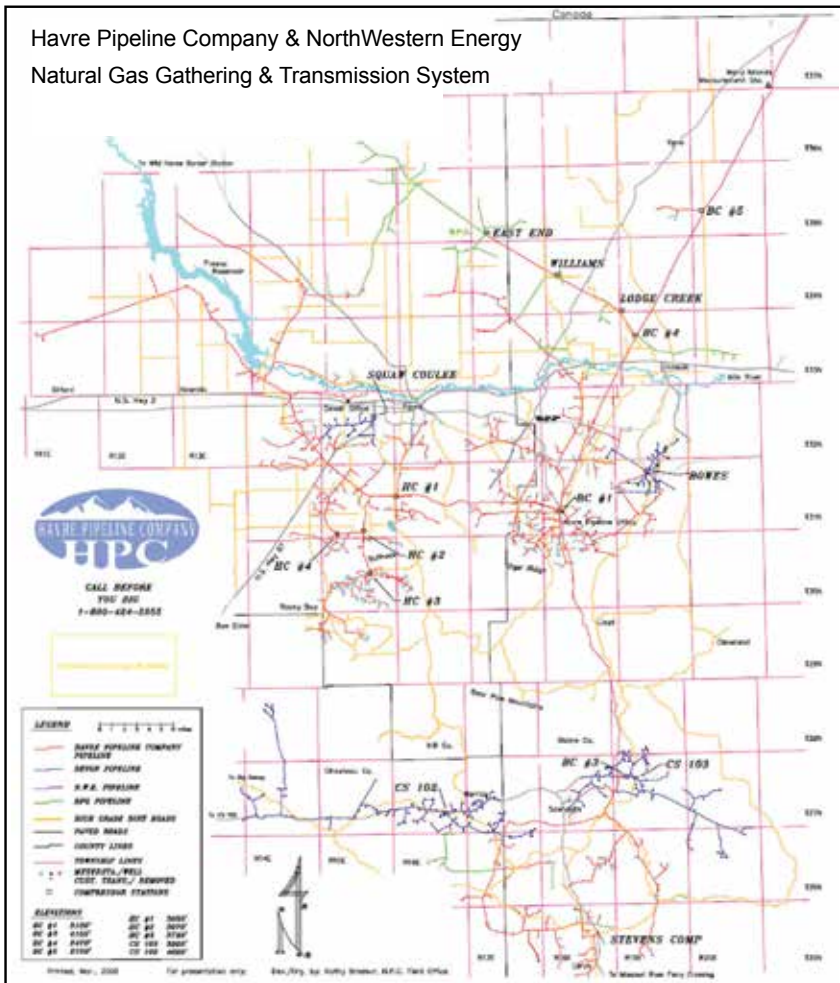

NATURAL GAS INCIDENTS

Please familiarize yourself with these general rules.

When Natural Gas is Escaping Outside and Burning	When Natural Gas is Escaping Inside and Burning
<ol style="list-style-type: none"> 1. Clear the area. 2. Call NorthWestern Energy's emergency number (1-800-245-6977) for the gas service technician on duty 3. Let the natural gas burn until the source of the fuel is shut off. 4. Prevent ignition of nearby combustibles. 	<ol style="list-style-type: none"> 1. Clear occupants from the building. 2. Call NorthWestern Energy's emergency number (1-800-245-6977) for the gas service technician on duty 3. Let the fire burn until the gas has been shut off. 4. Shut off gas at the meter if safe to do so.
When Natural Gas is Escaping Outside and Not Burning	When Natural Gas is Escaping Inside and Not Burning
<ol style="list-style-type: none"> 1. Clear the area. 2. Call NorthWestern Energy's emergency number (1-800-245-6977) for the gas service technician on duty 3. Close air intake sources, such as windows, doors, and ventilation systems in nearby windows. 4. Reroute or restrict traffic. 5. Remove or extinguish open flames. 6. Prohibit smoking. 7. Do not use anything electrical including lights, switches, or phones, or take any other actions that might produce sparks. Turn any equipment or vehicles off, if possible, because running equipment can be a source of ignition. Leave the equipment in place - do not try to move it out of the gaseous environment. 	<ol style="list-style-type: none"> 1. Clear occupants from the building. 2. Call NorthWestern Energy's emergency number (1-800-245-6977) for the gas service technician on duty 3. Turn off gas supply if safe to do so. 4. Eliminate sources of ignition. 5. Ventilate the building by opening windows and doors. 6. Do Not - <ul style="list-style-type: none"> • Allow smoking • Ring the doorbell • Use the telephone • Operate electrical switches (on and off) • Pull the electric meter • Use power fans or exhausters
<p>If it is necessary to close or turn off a natural gas valve before your NorthWestern Energy gas service technician arrives, leave it closed until NorthWestern Energy personnel can restore service.</p>	




Montana-Dakota Utilities Co.
400 N. Fourth St.
Bismarck, ND 58501
Website: www.montana-dakota.com

PIPELINE PURPOSE AND RELIABILITY

Montana-Dakota Utilities Co. (Montana-Dakota) operates approximately 7,500 miles of main line natural gas facilities. This natural gas is delivered for household, commercial and industrial use. Montana-Dakota operates a safe and efficient pipeline distribution network of stations, mains, services and meters. Natural gas is the most popular home heating fuel in America, and the pipelines are among the safest and most secure methods of transporting energy.

In addition, pipeline operators are extensively regulated by federal and state regulations with regard to design, construction, operation and maintenance. The natural gas industry works diligently to stay abreast of new safety methods and technologies to ensure the highest levels of security. Montana-Dakota maintains memberships in industry associations, and we continually evaluate our security procedures for enhancement. At Montana-Dakota our primary goal is to deliver natural gas reliably and safely to you, our customer. In doing so, we want you to know what to do if you ever smell gas or if a natural gas pipeline emergency occurs where you live or work.

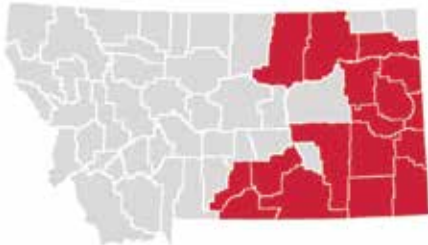

HAZARD AWARENESS & PREVENTION MEASURES

Natural gas pipelines have the best safety record of any type of transportation system in the United States. Natural gas is clean, convenient and efficient, which makes it the popular energy of choice. Like all forms of energy, however, it must be handled properly. Despite an excellent safety record, a gas leak caused by damage to a pipeline may pose a hazard and has the potential to ignite. Montana-Dakota works diligently to ensure the safety of our pipeline through a variety of measures.



EMERGENCY CONTACT:
1-800-638-3278

PRODUCTS/DOT GUIDEBOOK ID#/GUIDE#:		
Natural Gas	1971	115

MONTANA COUNTIES OF OPERATION:

Big Horn	Prairie
Carbon	Richland
Carter	Rosebud
Custer	Roosevelt
Dawson	Stillwater
Fallon	Valley
McCone	Wibaux
Phillips	Yellowstone
Powder River	

Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.

UTILITY MARKERS

For your safety, markers show the approximate location of pipelines and identify the companies that own and operate them. Markers may be anywhere along the right-of-way or directly over the pipelines. The pipeline may not follow a straight course between markers. While markers are helpful in locating pipelines, they provide limited information. They provide no information, for example, on depth or number of pipelines in the right-of-way. The markers can be found where pipelines intersect a street, highway or railroad. These markers display the material transported in the pipeline, the name of the pipeline operator, and telephone number where the pipeline operator can be reached in the event of an emergency. You should be aware of any pipeline markers in your neighborhood and, if possible, write down the name and phone numbers appearing on the pipeline markers in case of an emergency.

For additional information please contact Montana-Dakota at awareness@mdu.com or 1-800-638-3278.



Andeavor Field Services LLC, a wholly owned subsidiary of MPLX, is committed to public safety protection of the environment and compliance with applicable rules and regulations. Public awareness and education is of primary importance to MPLX.

You can help keep our community and environment safe from a pipeline emergency by following the safety guidelines and information below.

DIGGING NEAR A PIPELINE

The primary cause of pipeline leaks is damage from construction-related activities.

- Contact the One-Call Center before digging near a pipeline, at least 2 business days before planned work activity by contacting **Montana811**.
- Do not disturb the ground until all pipelines are marked.
- Abide by all location markers and instructions provided by the pipeline/utility representatives.
- Do not use power equipment around the pipelines within the “Tolerance Zone” which is 18” around the entire diameter of the pipeline being excavated.
- If a pipeline is or becomes damaged, immediately leave the area.
- When you reach a safe area, call 911 and the MPLX emergency number **(866) 283-7676**.

IDENTIFYING AND PROTECTING PIPELINES

The pipeline right of way must be kept clear of any buildings, structures, trees, shrubs, excess vegetation, fence posts, electric / telephone poles or other “encroachments” which might damage and restrict access to the pipeline. The right of way protects the public and the pipeline. If you notice any possible encroachments on MPLX G&P’s, pipeline right of way or if you need to install a structure near the right of way, please call the state One-Call Center, **Montana811**.

Pipeline markers are located along our pipeline right of way to help identify the approximate location of our pipeline. MPLX pipeline markers list the commodity transported and our 24-hour telephone number where a person can be reached at any time **(866) 283-7676**



If you know of a damaged or missing pipeline marker, or have seen someone damaging or vandalizing our markers, please report it to MPLX. It’s against the law for any person to willfully and knowingly deface, damage, remove, or destroy any pipeline sign or right of way marker.

EMERGENCY CONTACT:
1-866-283-7676

MONTANA
COUNTIES OF OPERATION:

Dawson	Richland
--------	----------

Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.



HOW TO RECOGNIZE A PIPELINE EMERGENCY

The following items may indicate a Natural Gas or Natural Gas Liquid leak or failure:

- | Gas | Liquid |
|---|--|
| <ul style="list-style-type: none">• Gas escaping from the pipeline• Hissing or spewing sound• Dead vegetation• Fire at or near the pipeline• Hole in the ground• Rotten egg odor• Frozen ground | <ul style="list-style-type: none">• Liquid escaping from the pipeline• Spewing sound• Dead vegetation• Erosion• Petroleum odor• Low lying vapor –similar to fog• Frozen ground |

REPORTING OF EMERGENCIES:

- Call **911**
- Contact MPLX Emergency Number **(866) 283-7676**

WHAT TO DO IN THE EVENT OF A NATURAL GAS EMERGENCY

Excavators

- Do not drive into the area where the leak or vapor cloud is located
- Do not make contact with escaping liquids or vapors
- Avoid possible ignition sources (e.g., turn off and abandon all equipment, vehicles, and or generators being used in the affected area)
- Do not light a match, start an engine or automobile, use a telephone, switch on/off an electric light, or ring doorbells
- Immediately leave the area, on foot in an upwind direction
- From a safe distance call 911 and the MPLX emergency number **(866) 283-7676**.
- Wait, if in a safe area, for MPLX personnel to arrive on site and do not try to operate any pipeline valves
- Warn others to stay away from the area

PUBLIC OFFICIALS & EMERGENCY RESPONDERS

- Evacuate people (homes, businesses, schools...etc.) to an upwind area
- Secure area around the leak
- If the pipeline leak is not burning, take steps to prevent ignition such as prohibiting smoking, and rerouting traffic away from the leak.
- If the pipeline is burning, take steps to prevent secondary fires, but do not attempt to extinguish a pipeline fire unless asked to do so by MPLX
- Do not try to operate any pipeline valves
- Call the MPLX emergency number **(866) 283-7676** as soon as possible
- Administer medical treatment and request additional emergency response assistance as necessary



11 E. Park St
Butte, MT 59701
Phone: 888-467-2669
Website: www.northwesternenergy.com

Montana Natural Gas Fact Sheet

OUR SERVICE

We transmit natural gas in Montana from production receipt points and storage facilities to distribution points and other nonaffiliated transmission systems.

- 2,100 miles of transmission pipelines
 - 2" to 24" diameter pipelines
 - 130 city gate stations
- Connections with four major nonaffiliated transmission systems
 - Williston Basin Interstate Pipeline
 - NOVA Gas Transmission Ltd.
 - Colorado Interstate Gas
 - Spur Energy
- 7 compressor stations capable of moving more than 335,000 dekatherms per day
- Own and operate a pipeline border crossing from Canada through our wholly owned subsidiary, Canadian-Montana Pipe Line Corporation

- 16 Bcf of gas storage capacity
 - Own and operate three working natural gas storage fields
 - Maximum aggregate daily deliverability of approximately 195,000 dekatherms per day

OUR COMMITMENT TO SAFETY, HEALTH AND ENVIRONMENT

NorthWestern Energy is committed to public safety, protection of the environment, and operation of its facilities in compliance with all applicable rules and regulations. NorthWestern Energy adheres to the regulatory oversight of the Office of Pipeline Safety in the U.S. Department of Transportation. The company is proud of its safety record and follows many regulations and procedures to monitor and ensure the integrity of its pipelines.

EMERGENCY CONTACT:

1-888-467-2669

PRODUCTS/DOT GUIDEBOOK ID#/GUIDE#:


Natural Gas	1971	115
-------------	------	-----

MONTANA COUNTIES OF OPERATION:

Beaverhead	Lewis and Clark
Big Horn	Liberty
Blaine	Madison
Broadwater	Missoula
Carbon	Park
Cascade	Pondera
Chouteau	Powell
Deer Lodge	Ravalli
Fergus	Silver Bow
Flathead	Stillwater
Gallatin	Sweet Grass
Glacier	Teton
Golden	Toole
Granite	Valley
Hill	Wheatland
Jefferson	Yellowstone

Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.

OUR NATURAL GAS TRANSMISSION LINES AND DISTRIBUTION SERVICE AREA

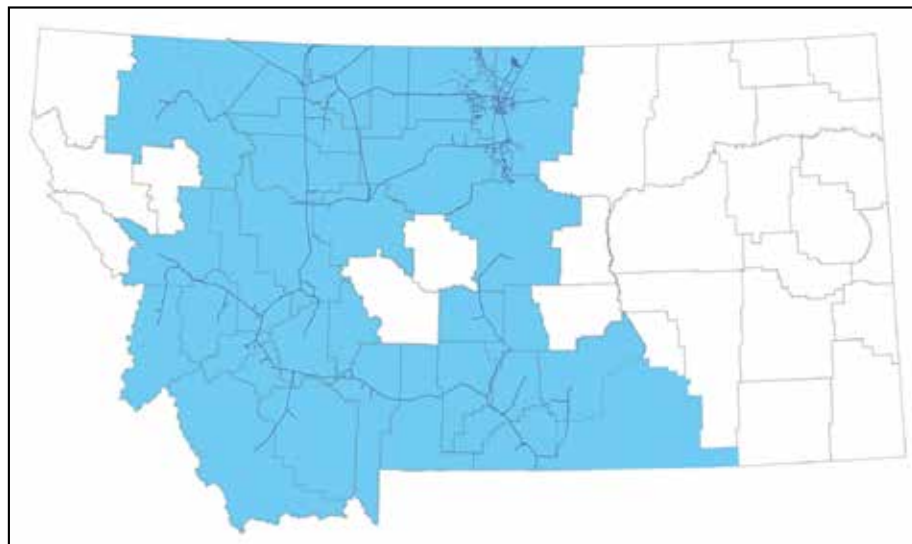

- 190,000 gas distribution customers in 105 communities
- 4,700 miles of distribution gas mains
- 2,100 miles of transmission pipelines
- 16 bcf of gas storage

For additional resources specifically concerning natural gas training and/or review of NorthWestern Energy's emergency response plan contact:

Teresa McGrath
Phone: (406) 497-2446
teresa.mcgrath@northwestern.com

Barry J. O'Leary
Phone: (406) 497-2406
barry.oleary@northwestern.com

Joseph Brent
Phone: (406) 655-2514
joseph.brent@northwestern.com

EMERGENCY CONTACT:
MT: 1-888-467-2669

We're on call 24 hours a day to respond to your emergencies. Make sure you place your call from a telephone located far enough away from the danger area.

Be sure to tell us the following information:

- The location including the street address and city where the incident is taking place
- Details of the incident
- Whether gas is leaking or burning inside or outside
- Details of any evacuations (numbers of people affected and the area affected)
- Your name and organization pipelines

NATURAL GAS INCIDENTS

Please familiarize yourself with the general rules presented within this chart.

When Natural Gas is Escaping Outside and Burning	When Natural Gas is Escaping Inside and Burning
<ol style="list-style-type: none"> 1. Clear the area. 2. Call NorthWestern Energy's emergency number (1-888-467-2669) for the gas service technician on duty 3. Let the natural gas burn until the source of the fuel is shut off. 4. Prevent ignition of nearby combustibles. 	<ol style="list-style-type: none"> 1. Clear the area. 2. Call NorthWestern Energy's emergency number (1-888-467-2669) for the gas service technician on duty 3. Let the fire burn until the gas has been shut off. 4. Shut off gas at the meter.
When Natural Gas is Escaping Outside and Not Burning	When Natural Gas is Escaping Inside and Not Burning
<ol style="list-style-type: none"> 1. Clear the area. 2. Call NorthWestern Energy's emergency number (1-888-467-2669) for the gas service technician on duty 3. Close air intake sources, such as windows, doors, and ventilation systems in nearby windows. 4. Reroute or restrict traffic. 5. Remove or extinguish open flames. 6. Prohibit smoking. 7. Do not use anything electrical including lights, switches, or phones, or take any other actions that might produce sparks. Turn any equipment or vehicles off, if possible, because running equipment can be a source of ignition. Leave the equipment in place - do not try to move it out of the gaseous environment. 	<ol style="list-style-type: none"> 1. Clear the area. 2. Call NorthWestern Energy's emergency number (1-888-467-2669) for the gas service technician on duty 3. Turn off gas supply. 4. Eliminate sources of ignition. 5. Ventilate the building by opening windows and doors. 6. Do Not - <ul style="list-style-type: none"> • Allow smoking • Ring the doorbell • Use the telephone • Operate electrical switches (on and off) • Pull the electric meter • Use power fans or exhausters
<p>If it is necessary to close or turn off a natural gas valve before your NorthWestern Energy gas service technician arrives, leave it closed until NorthWestern Energy personnel can restore service.</p>	



ONEOK
NGL PIPELINE

A SUBSIDIARY OF ONEOK



**Know what's below.
Call before you dig.**

Local Office:
130 Commerce Drive
Spearfish, SD 57783

ONEOK Plaza
100 West Fifth Street
Tulsa, OK 74103
Phone: 918-588-7000
Website: www.oneok.com

ABOUT ONEOK, INC.

ONEOK, Inc. is a leading midstream service provider that owns one of the nation's premier natural gas liquids systems, connecting NGL supply in the Mid-Continent, Permian and Rocky Mountain regions with key market centers and an extensive network of natural gas gathering, processing, storage and transportation assets.

ONEOK applies our core capabilities of gathering, processing, fractionating, transporting, storing and marketing natural gas and NGLs through vertical integration across the midstream value chain to provide our customers with premium services while generating consistent and sustainable earnings growth.

In Montana, ONEOK NGL Pipeline LLC operates 271 miles of natural gas pipeline with the pipeline diameters ranging between 4"-20".

COMMITMENT TO SAFETY, HEALTH & THE ENVIRONMENT

ONEOK is committed to operating in a safe, reliable, environmentally responsible and sustainable manner. Environmental, safety and health is our primary focus at ONEOK. ONEOK is purposeful in improving employee and process safety. Our key performance indicators keep ONEOK focused improving results. We continue to make improvements in reducing our environmental impact by conserving resources, recycling and utilizing efficient technologies.

EMERGENCY NOTIFICATION(S) :

Call 911 first when requiring assistance in responding to a pipeline event.

Call ONEOK's 24 hour emergency number 855-348-7258 and provide the following information:

- Location;
- Nature of the problem; and
- A telephone number at which a responsible person can be contacted.

EMERGENCY RESPONSE PERSONNEL

Although Emergency Officials are familiar with the steps required to safeguard the public, ONEOK has planned responses to unique emergency situations that may arise with its pipeline facilities and operations. It is important that ONEOK practice their emergency response efforts to be prepared when an unlikely event occurs.

EMERGENCY RESPONSE PLANS

ONEOK has developed specific facility response plans based on the knowledge of its own personnel, available equipment, tools and materials. These plans are accessible at each facility. This document provides a general overview of ONEOK's capabilities. For more detailed information or to review the Emergency Response Plan, please contact Donnie Krumsiek at 918-561-8019.

MUTUAL UNDERSTANDING

In the unlikely event of a pipeline emergency, ONEOK employees are prepared to respond in coordination with local police and fire departments and other emergency responders. We meet with responders to discuss our emergency response plans and each plan is designed to protect people, the environment and property.

If a pipeline event occurs, emergency response officials will be notified, and ONEOK operations personnel will be dispatched to the site. ONEOK response personnel will respond putting safety first in their response efforts.

If you or another emergency response organization established an Incident Command Center prior to the arrival of ONEOK personnel, the first ONEOK employee who arrives at the site should be introduced to the Incident Commander as the ONEOK Representative..

EMERGENCY CONTACT:

1-800-666-9041

PRODUCTS/DOT GUIDEBOOK ID#/GUIDE#:
Natural Gas Liquids 1972 115

MONTANA COUNTIES OF OPERATION:

Carter	Richland
Fallon	Wibaux

Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.

PUBLIC SAFETY AND EVACUATIONS

Evacuation plans and procedures should reflect your department's available assets and capabilities of your emergency response organization. Expert knowledge of your area is key to creating the best evacuation, traffic control and rerouting, and railroad stoppage plans in order to limit public exposure and minimize accidental ignition.

ONEOK will provide product hazard information to the emergency responders to assist in establishing safe zones relative to the products which are being transported through the pipeline system. These established safe zones will assist in identification of those whom may be requested to evacuate the area.

FIRE OR EXPLOSION

ONEOK does not employ dedicated fire response personnel and must rely on the capabilities of local emergency responders. ONEOK through memberships in state pipeline associations, provide training opportunities to Emergency Responders. Other agencies, including the State Fire Marshall's office may also provide pipeline emergency response training. The U.S. Department of Transportation Emergency Response Guidebook provides information on potential hazards, public safety and emergency response.

RESCUE OR MEDICAL DUTIES

Emergency response personnel will be contacted to assist with any needed rescue. Coordination will be made with emergency services and/or with a local hospital or medical provider in the event of a medical emergency.

PIPELINE EQUIPMENT AND FACILITIES

Federal law requires that pipeline operators to have specific training when operating a pipeline system. ONEOK requests that Emergency Officials not attempt to operate pipeline valve or equipment. In doing so, these actions may worsen an event.

BOMB OR SECURITY THREAT

ONEOK relies on the public to be its eyes and ears along the pipeline. If you witness any act of vandalism, loitering, receive a bomb threat involving a ONEOK facility or other suspicious activity along the right of way or pipeline facility, please report it immediately to the ONEOK's Pipeline Control Center at 855-348-7258.

NATURAL DISASTERS

When a natural disaster (hurricane, storm, flood, tornado, volcano or earthquake) strikes or is pending, the area will be closely monitored. Pipeline facilities will be inspected after the disaster. ONEOK personnel may contact emergency officials to assist in identifying any road closures that may hamper accessibility to the facility. If damage occurs in your area please contact ONEOK and a field employee will respond to the concern or damage which has been reported.

RIGHT-OF-WAY ACTIVITY

One of the greatest threats to safe pipeline operation is the accidental damage caused by excavation, construction, farming activities, and homeowner construction and maintenance. Awareness is crucial in preventing these accidents. Call IMMEDIATELY if you see suspicious or questionable activity near the pipeline right of way.

Be aware that pipelines frequently share rights of way with other utilities (electric power lines, additional pipelines) or modes of transportation (roadways, railroads, etc.). Incidents such as lightning strikes, fires, train derailments, etc. on or near the right of way can damage an underground pipeline. Should incidents such as these occur and a pipeline operated by ONEOK is nearby, please call the ONEOK emergency number at 855-348-7258 to report the incident.

NATIONAL PIPELINE MAPPING SYSTEM

The US Department of Transportation, Pipeline and Hazardous Materials Safety Administration, Office of Pipeline Safety has created a web-based system to assist emergency responders in locating and identifying pipelines within their area as well as the Operator of the pipeline system.


Not all of ONEOK pipelines are included in the NPMS mapping system. Production, distribution and gathering pipelines are exempt from reporting pipelines into the National Pipeline Mapping System.

INTEGRITY MANAGEMENT

In accordance with federal regulatory requirements, ONEOK has developed a hazard assessment program known as an Integrity Management Plan (IMP). This plan focuses on the identification and mitigation of hazards to the pipeline system. Specific information about ONEOK's program may be found by contacting our Integrity Manager, Scott Henderson at ScottBrian.Henderson@oneok.com.

CLOSURE

ONEOK values Emergency Officials and Responders. We appreciate the knowledge and capabilities each responder brings when assisting in a pipeline emergency. If ONEOK can offer your department any additional information, please contact us.

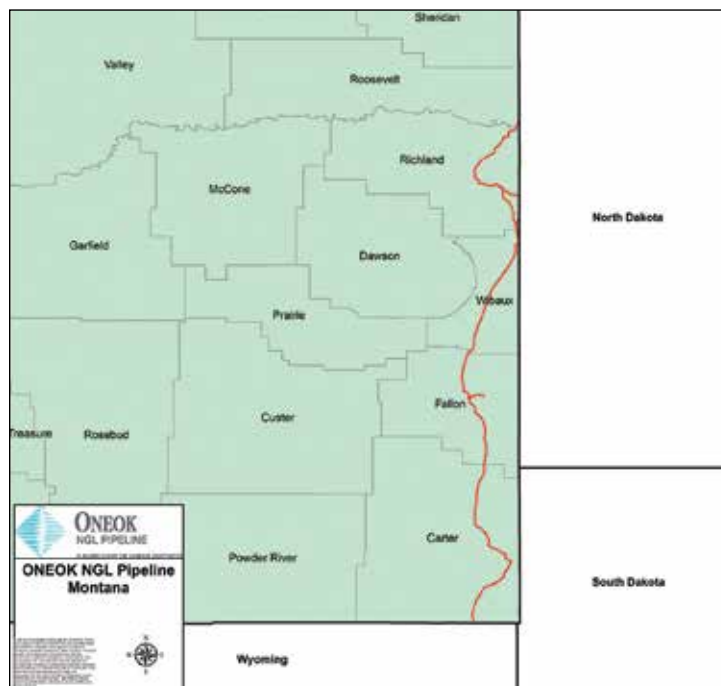

**CONTACT
US**

pipelineawareness@oneok.com | 1-918-561-8019 | www.oneok.com
Emergency Number: 1-800-666-9041



ONEOK
ROCKIES MIDSTREAM
A SUBSIDIARY OF ONEOK



Local Office:
896 25th Street SE
Sidney, MT 59270

ONEOK Plaza
100 West Fifth Street
Tulsa, OK 74103
Phone: 918-588-7000
Website: www.oneok.com

ABOUT ONEOK, INC.

Oneok Rockies Midstream, LLC is a wholly owned subsidiary of ONEOK, Inc. The company's natural gas gathering and processing segment gathers, compresses and transports raw natural gas through pipelines to our processing facilities for the removal of water vapor, solids and other contaminants and the extraction of valuable natural gas liquids. The liquids in the form of a mixed NGL stream are generally shipped to fractionators, where by applying heat and pressure, the mixed NGL stream is separated into marketable products and sold to refineries or local markets. The remaining residue gas, which consists primarily of methane, is compressed and delivered to natural gas pipelines for transportation to the end user. These activities are conducted through ONEOK Field Services Company (OFS) and Oneok Rockies Midstream, LLC. These activities are conducted in Oklahoma, Kansas, North Dakota, Montana and Wyoming.

In Montana, ONEOK Rockies Midstream LLC operates 1251 miles of natural gas pipeline with the pipeline diameters ranging between 2"-20".

COMMITMENT TO SAFETY, HEALTH & THE ENVIRONMENT

ONEOK is committed to operating in a safe, reliable, environmentally responsible and sustainable manner. Environmental, safety and health is our primary focus at ONEOK. ONEOK is purposeful in improving employee and process safety. Our key performance indicators keep ONEOK focused improving results. We continue to make improvements in reducing our environmental impact by conserving resources, recycling and utilizing efficient technologies.

EMERGENCY NOTIFICATION(S) :

Call 911 first when requiring assistance in responding to a pipeline event.

Call ONEOK's 24 hour emergency number 800-778-7834 and provide the following information:

- Location;
- Nature of the problem; and
- A telephone number at which a responsible person can be contacted.

EMERGENCY RESPONSE PERSONNEL

Although Emergency Officials are familiar with the steps required to safeguard the public, ONEOK has planned responses to unique emergency situations that may arise with its pipeline facilities and operations. It is important that ONEOK practice their emergency response efforts to be prepared when an unlikely event occurs.

EMERGENCY RESPONSE PLANS

ONEOK has developed specific facility response plans based on the knowledge of its own personnel, available equipment, tools and materials. These plans are accessible at each facility. This document provides a general overview of ONEOK's capabilities. For more detailed information or to review the Emergency Response Plan, please contact Donnie Krumsiek at 918-561-8019.

MUTUAL UNDERSTANDING

In the unlikely event of a pipeline emergency, ONEOK employees are prepared to respond in coordination with local police and fire departments and other emergency responders. We meet with responders to discuss our emergency response plans and each plan is designed to protect people, the environment and property.

If a pipeline event occurs, emergency response officials will be notified, and ONEOK operations personnel will be dispatched to the site. ONEOK response personnel will respond putting safety first in their response efforts.

If you or another emergency response organization established an Incident Command Center prior to the arrival of ONEOK personnel, the first ONEOK employee who arrives at the site should be introduced to the Incident Commander as the ONEOK Representative..

**EMERGENCY CONTACT:
1-800-778-7834**

PRODUCTS/DOT GUIDEBOOK ID#/GUIDE#:		
Natural Gas	1971	115

**MONTANA
COUNTIES OF OPERATION:**

Fallon	Roosevelt
Richland	Sheridan

Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.

PUBLIC SAFETY AND EVACUATIONS

Evacuation plans and procedures should reflect your department's available assets and capabilities of your emergency response organization. Expert knowledge of your area is key to creating the best evacuation, traffic control and rerouting, and railroad stoppage plans in order to limit public exposure and minimize accidental ignition.

ONEOK will provide product hazard information to the emergency responders to assist in establishing safe zones relative to the products which are being transported through the pipeline system. These established safe zones will assist in identification of those whom may be requested to evacuate the area.

FIRE OR EXPLOSION

ONEOK does not employ dedicated fire response personnel and must rely on the capabilities of local emergency responders. ONEOK through memberships in state pipeline associations, provide training opportunities to Emergency Responders. Other agencies, including the State Fire Marshall's office may also provide pipeline emergency response training. The U.S. Department of Transportation Emergency Response Guidebook provides information on potential hazards, public safety and emergency response.

RESCUE OR MEDICAL DUTIES

Emergency response personnel will be contacted to assist with any needed rescue. Coordination will be made with emergency services and/or with a local hospital or medical provider in the event of a medical emergency.

PIPELINE EQUIPMENT AND FACILITIES

Federal law requires that pipeline operators to have specific training when operating a pipeline system. ONEOK requests that Emergency Officials not attempt to operate pipeline valve or equipment. In doing so, these actions may worsen an event.

BOMB OR SECURITY THREAT

ONEOK relies on the public to be its eyes and ears along the pipeline. If you witness any act of vandalism, loitering, receive a bomb threat involving a ONEOK facility or other suspicious activity along the right of way or pipeline facility, please report it immediately to the ONEOK’s Pipeline Control Center at 800-778-7834.

NATURAL DISASTERS

When a natural disaster (hurricane, storm, flood, tornado, volcano or earthquake) strikes or is pending, the area will be closely monitored. Pipeline facilities will be inspected after the disaster. ONEOK personnel may contact emergency officials to assist in identifying any road closures that may hamper accessibility to the facility. If damage occurs in your area please contact ONEOK and a field employee will respond to the concern or damage which has been reported.

RIGHT-OF-WAY ACTIVITY

One of the greatest threats to safe pipeline operation is the accidental damage caused by excavation, construction, farming activities, and homeowner construction and maintenance. Awareness is crucial in preventing these accidents. Call IMMEDIATELY if you see suspicious or questionable activity near the pipeline right of way.

Be aware that pipelines frequently share rights of way with other utilities (electric

power lines, additional pipelines) or modes of transportation (roadways, railroads, etc.). Incidents such as lightning strikes, fires, train derailments, etc. on or near the right of way can damage an underground pipeline. Should incidents such as these occur and a pipeline operated by ONEOK is nearby, please call the ONEOK emergency number at 800-778-7834 to report the incident.

NATIONAL PIPELINE MAPPING SYSTEM

The US Department of Transportation, Pipeline and Hazardous Materials Safety Administration, Office of Pipeline Safety has created a web-based system to assist emergency responders in locating and identifying pipelines within their area as well as the Operator of the pipeline system.


Not all of ONEOK pipelines are included in the NPMS mapping system. Production, distribution and gathering pipelines are exempt from reporting pipelines into the National Pipeline Mapping System.

INTEGRITY MANAGEMENT

In accordance with federal regulatory requirements, ONEOK has developed a hazard assessment program known as an Integrity Management Plan (IMP). This plan focuses on the identification and mitigation of hazards to the pipeline system. Specific information about ONEOK’s program may be found by contacting our Integrity Manager, Scott Henderson at ScottBrian.Henderson@oneok.com.

CLOSURE

ONEOK values Emergency Officials and Responders. We appreciate the knowledge and capabilities each responder brings when assisting in a pipeline emergency. If ONEOK can offer your department any additional information, please contact us.

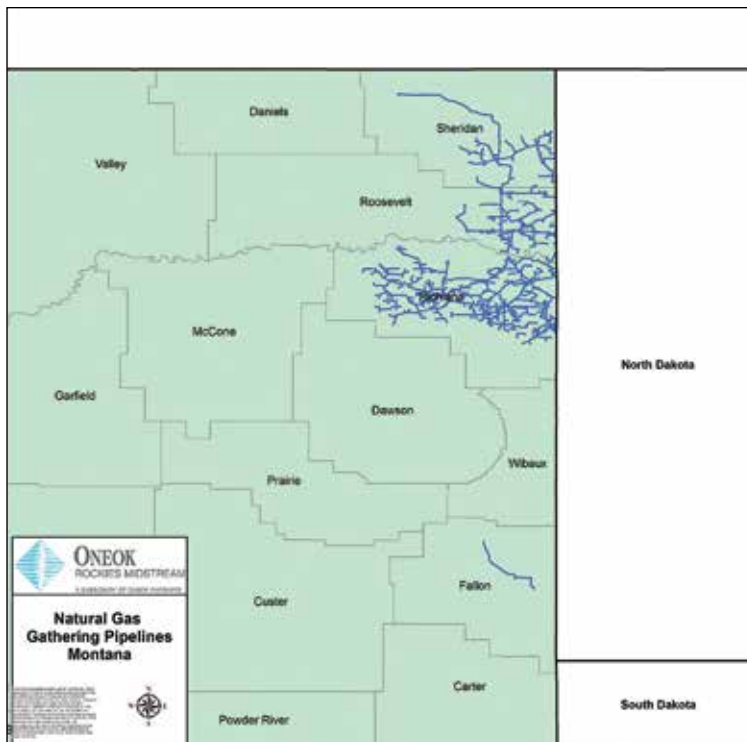

CONTACT US | pipelineawareness@oneok.com | 1-918-561-8019 | www.oneok.com
 Emergency Number: 1-800-778-7834



Corporate Headquarters:
 Phillips 66 Pipeline LLC
 2331 Citywest Blvd
 Houston, TX 77042
www.phillips66pipeline.com

PHILLIPS 66 PIPELINE LLC OWNS OR OPERATES APPROXIMATELY 1,500 MILES OF PIPELINE AND 5 STORAGE TERMINALS IN MONTANA

Operating with Integrity

Pipelines are one of the most reliable methods to move energy products, helping to meet our nation's growing economic and energy needs. They operate under many government regulations and industry standards. These measures address all aspects of pipeline operation, such as where and how they are built, operated and maintained -- and Phillips 66 Pipeline LLC applies best practices that often exceed requirements.

Committed to Safety and Reliability

Our commitment to safety goes further, with the goal that everyone who lives or works near our assets is aware of our lines and facilities, adopts safe digging practices, learns the signs of a potential pipeline leak and knows how to quickly respond if he or she suspects a problem. As part of our on-going damage prevention program, we employ many tactics to ensure the safety of our communities.

Emergency Response Capabilities

Phillips 66 Pipeline LLC has committed resources to prepare and implement its emergency response plans and has obtained, through contract, the necessary private personnel and equipment to respond to a worst case discharge, to the maximum extent practical.

Communications

Phillips 66 Pipeline LLC employs a 24-hour Control Center as a hub of communication in emergency response situations. On-site communications are conducted using cellular phones; and portable radios and/or land-line telephone systems from facilities and offices.

Incident Command System

Phillips 66 Pipeline LLC utilizes an expandable Incident Command System. Personnel and federal, state and local agencies may be integrated into the Unified Command Structure, scalable to the size and complexity of an incident.

Spill Response Equipment

Phillips 66 Pipeline LLC maintains emergency response trailers and equipment at strategically-located facilities. Response equipment may include spill boom (as needed and of various types, sizes and lengths), absorbent materials, boats, motors, hand and power tools, pumps, hoses, personal protective equipment (PPE), first aid and miscellaneous supplies. Each trailer is inspected; equipment is deployed during drills on a regular basis.

Oil Spill Contractors

Certified Oil Spill Response Organizations (OSROs) are under contract by Phillips 66 Pipeline LLC for use in this area. Oil Spill Response Limited (OSRL) and associated STAR Contractors are used globally.

The Phillips 66 Pipeline LLC Emergency Response Action Plan (ERAP) contains specific contact and resource information for these companies. In addition, these OSROs are invited to participate in training and pre-planning exercises with Phillips 66 Pipeline LLC local and regional response teams. OSROs and Co-Ops can be relied upon for an appropriate level of response, with spill response equipment and trained personnel.

EMERGENCY CONTACT:

1-877-267-2290

PRODUCTS/DOT GUIDEBOOK ID#/GUIDE#:

Crude Oil	1267	128
Diesel	1202	128
Gasoline	1203	128
Jet Fuel	1863	128

MONTANA COUNTIES OF OPERATION:

Big Horn	Missoula
Broadwater	Musselshell
Cascade	Park
Chouteau	Pondera
Fergus	Powell
Gallatin	Sanders
Glacier	Stillwater
Golden Valley	Sweet Grass
Granite	Teton
Jefferson	Toole
Judith Basin	Wheatland
Lewis and Clark	Yellowstone

Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.

Response Plans and Maps

To view and download emergency response plans and procedures, visit <https://my.spatialobjects.com/erpp/home>. To view and obtain GIS map files of our locations, visit <https://www.phillips66pipeline.com/maps/>



ADDITIONAL INFORMATION AND RESOURCES

Visit the following industry and government sites for important safety references and educational materials.

National Association of State Fire Marshal's "Pipeline Emergencies"
www.pipelineemergencies.com

PHMSA Emergency Response Guidebook
www.phmsa.dot.gov/hazmat/erg/emergency-response-guidebook-erg

National Pipeline Mapping System
www.npms.phmsa.dot.gov

Phillips 66 Pipeline LLC ERAP Portal
<https://my.spatialobjects.com/erpp/home>

Pipelines and Informed Planning Alliance
<http://primis.phmsa.dot.gov/comm/pipa/landuseplanning.htm>

CONTACT

PHILLIPS 66 PIPELINE LLC

Phillips 66 Pipeline LLC Headquarters
2331 Citywest Blvd
Houston, TX 77042
www.phillips66pipeline.com

Montana Office
Mike Kuntz, DOT Coordinator
3180 Hwy 12 East
Helena, MT 59601
406-441-4747

Non-Emergency Phone Number
800-231-2566

Emergency Phone Number
877-267-2290



Plains All American offers crude oil pipeline transportation services in most onshore producing regions in the U.S. and Canada. Our pipeline activities are conducted through Plains Pipeline, L.P. and Plains Marketing Canada, L.P.

The Belfield District pipeline gathers crude oil from production sites and transports the oil cross country to various destinations in North Dakota and Montana.

The Rocky Mountain Pipeline System gathers crude oil from production sites and transports the oil cross country to various destinations in Montana, Wyoming, and Colorado.

COMMITMENT TO SAFETY, HEALTH, & ENVIRONMENT

Plains All American and its affiliated limited partnerships adhere to high standards of environmental quality and are committed to providing a work place that protects the health and safety of our employees and the communities surrounding our facilities. In fulfillment of this commitment, the Partnership will:

- Comply with the laws, rules and regulations that pertain to the environment, health and safety, a business.
- Verify compliance through self monitoring programs and regular

facility assessments, and in a timely manner, correct any conditions in our operations that have a significant adverse health, safety or environmental impact.

- Train and empower each employee to recognize his or her responsibility and accountability to perform all activities in a manner that is safe for the employee, their co-worker and the environment.
- Establish and maintain corporate controls, including periodic reviews, to ensure that the Partnership's policy is being properly implemented and maintained.

**EMERGENCY CONTACT:
1-800-708-5071**

PRODUCTS/DOT GUIDEBOOK ID#/GUIDE#:		
Crude Oil	1267	128

**MONTANA
COUNTIES OF OPERATION:**

Carbon	Sheridan
Richland	Yellowstone

Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.

- Participate when possible with government on a federal, state, and local level in creating reasonable and attainable regulations to safeguard the community, workplace and the environment.
- Assess potential environmental, health or safety liabilities prior to the sale, lease, transfer or purchase of real property.
- Establish programs to analyze and mitigate risks, investigate significant environmental and safety incidents, and prepare for and respond to emergencies.

Headquarters:
333 Clay Street Suite 1600
Houston, TX 77002
Website: www.paalp.com

Local Office:
Belfield Office
P.O. Box 708
Belfield, ND 58622





Regional Office Contact – Bison Pipeline:
 Borders West Region - Dakota Area Office
 36997 128th St.
 Wetonka, SD 57481
 Office: 605-226-2259
 www.transcanada.com

PROJECT OVERVIEW

Bison Pipeline, LLC, entered commercial service on January 14, 2011. Bison is an interstate natural gas pipeline designed to transport gas from the Powder River Basin to the Midwest market. The pipeline provides producers in the Powder River Basin with additional natural gas pipeline capacity to access and meet increasing natural gas demand of the Midwest.

Bison is operated by TC Energy.

Bison consists of approximately 302 miles of 30-inch-diameter natural gas pipeline and related pipeline system facilities that extend northeastward from the Dead Horse Region near Gillette, Wyoming, through southeastern Montana and southwestern North Dakota where it interconnects with Northern Border Pipeline Company's (Northern Border) system near Northern Border's Compressor Station No. 6 in Morton County, North Dakota. Bison currently has 407 million cubic feet per day (MMcf/d) of operational capacity. Its design capacity with compression (approved but not yet constructed) is approximately 477 MMcf/d with potential

expandability to approximately 1 billion cubic feet per day. TC Energy is a leader in the responsible development and reliable operation of North American energy infrastructure including natural gas pipelines, power generation and gas storage facilities. TC Energy's network of 35,500 miles of wholly owned and 7,000 miles of partially owned pipelines connects virtually all major supply basins with major markets across North America.

RESPONDING TO EMERGENCIES

At TC Energy, safety of the public, our employees, and the environment is top priority. We have developed a comprehensive Emergency Management System (EMS) to ensure a quick and appropriate response to any pipeline emergency.

In the event of any emergency, our goal is to ensure an effective, coordinated response preventing harm to people, property, company operations, and the environment.

Our system is documented and tested regularly through annual exercises involving both our employees and

EMERGENCY CONTACT:
1-800-447-8066

PRODUCTS/DOT GUIDEBOOK ID#/GUIDE#:		
Natural Gas	1971	115

MONTANA COUNTIES OF OPERATION:


Carter	Powder River
Fallon	

Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.

the community. By working with our communities, TC Energy builds relationships with local first responders and community officials, informing each other of emergency response strategies and gaining an understanding of each other's roles and responsibilities.

We continuously improve our emergency response program by developing complex exercises to test emergency management procedures and by training staff in effective emergency response.



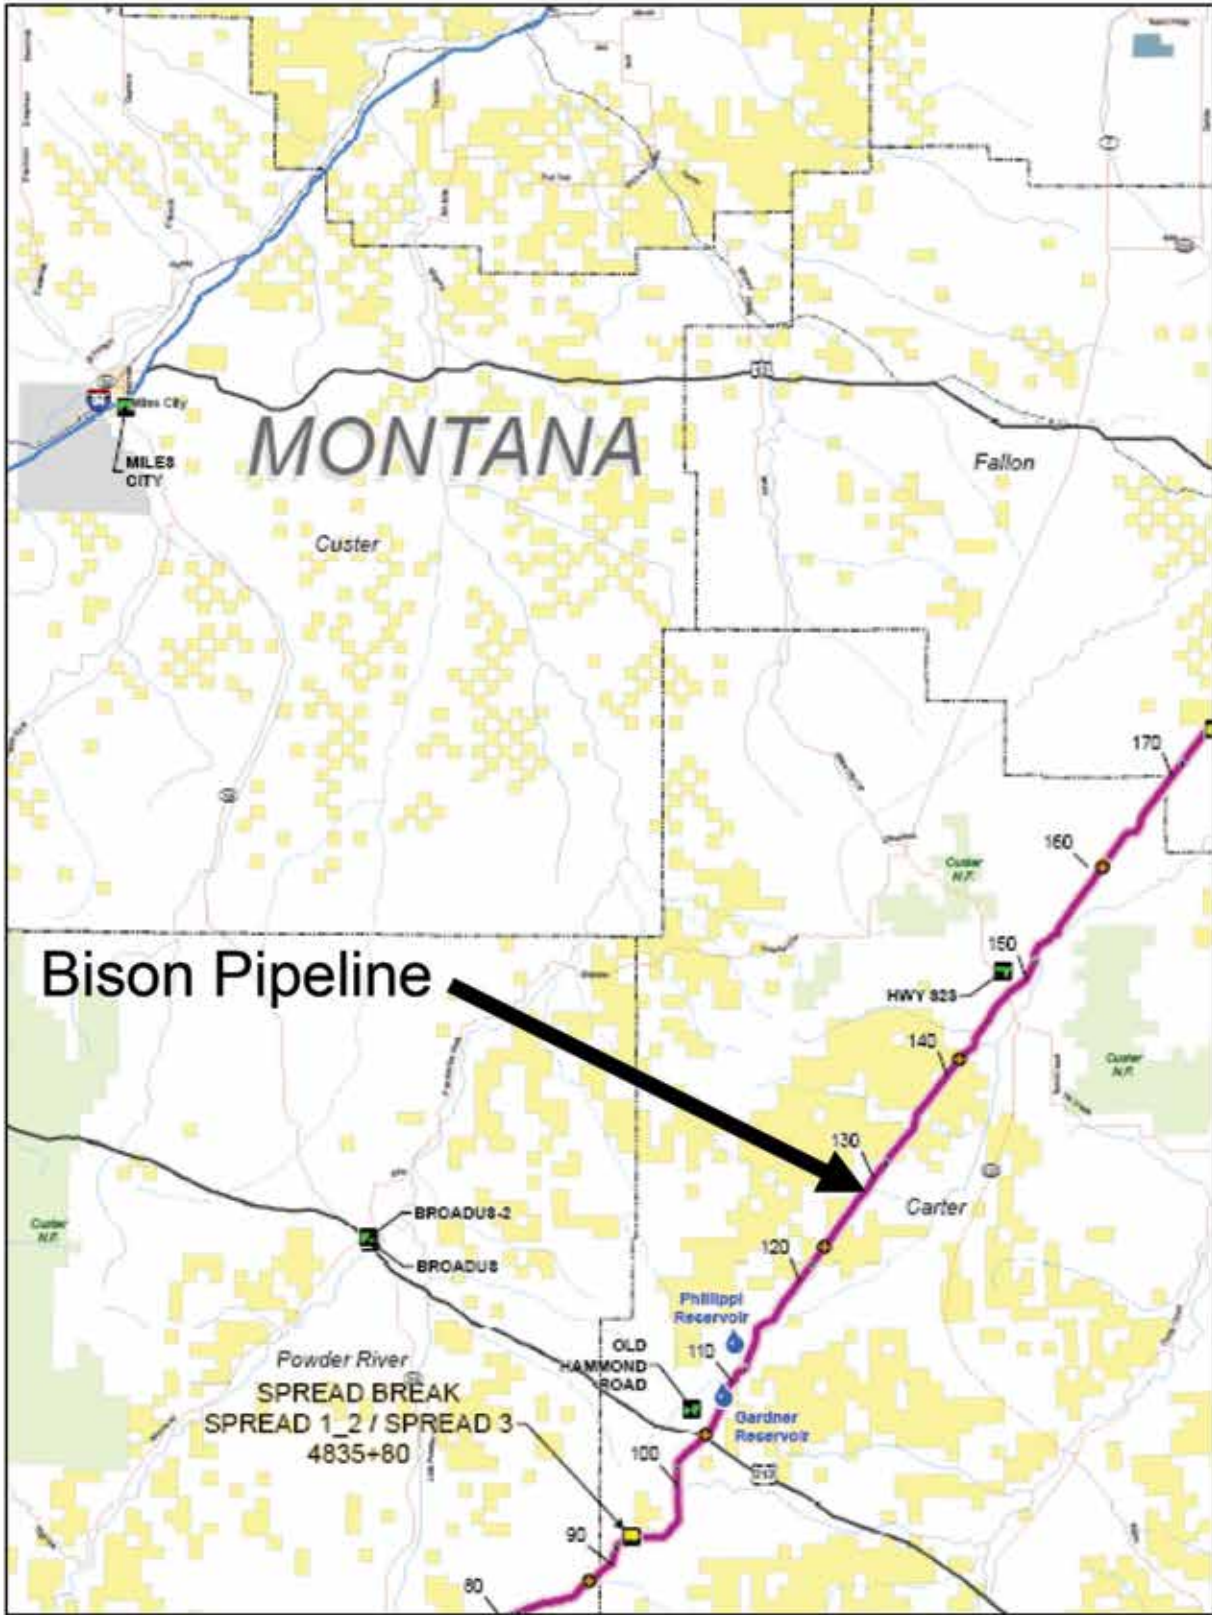

				DRAWN	BB	DATE	October 08, 2010	
				CHECKED		DATE		
				DESIGNED		DATE		
				APPROVED		DATE		
				CLIENT REVIEW		DATE		
				SCALE	1" = 32,500'	SHEET		
				JOB NO.				
				CLIENT				
				CLIENT JOB NO.				
							DRAWING NO.	ABC20-06-01-047-0265
							REV	1



BISON PIPELINE PROJECT
BISON PIPELINE, LLC
ROUTE MAP



TC Energy Northern Border Inc. operates the 1,249-mile Northern Border Pipeline interstate pipeline system that transports natural gas from the Montana-Saskatchewan border to interconnecting pipelines in the upper Midwestern United States and the Chicago market area. Northern Border Pipeline's primary source of natural gas is the Western Canada Sedimentary Basin. The pipeline system has a design capacity of 2,374 million cubic feet per day.

COMMITMENT TO SAFETY, HEALTH, & ENVIRONMENT

At Northern Border Pipeline Company, safety is our top priority. We incorporate a program that manages and maintains the integrity of our gas pipeline system. The purpose of this program is to provide safe, reliable and cost-

effective transportation of natural gas for our customers without adverse effects on the public, our customers, our employees or the environment. Line markers are used to indicate approximate locations of our pipeline and all excavators should use the state One-Call system or the national 811 One-Call.

Headquarters:

Northern Border Pipeline Company
13710 FNB Parkway
Omaha, NE 68154
Website: <http://www.northernborder.com/>

Local Office:

Northern Border Pipeline Company
200 Highway 14 Bypass
Brookings, SD 57006
Phone: 605-692-1415

EMERGENCY CONTACT:

1-800-447-8066


PRODUCTS/DOT GUIDEBOOK ID#/GUIDE#:

Natural Gas 1971 115

MONTANA COUNTIES OF OPERATION:

Phillips Valley
Roosevelt

Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.

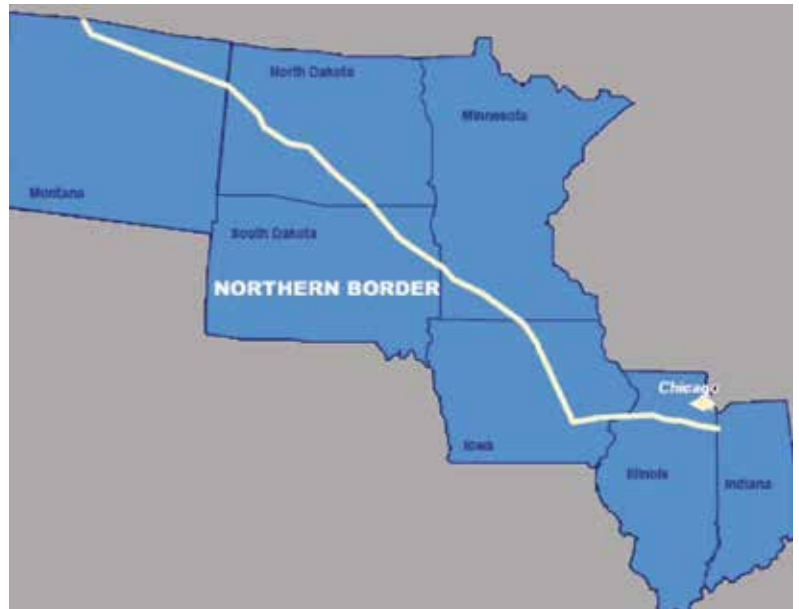



Local Office:
 WBI Energy Transmission
 2010 Montana Avenue
 Glendive, MT 59330
 Phone: 406-359-7200
 www.wbienergy.com

Headquarters
 1250 West Century Avenue
 Bismarck, ND 58503
 Phone: 701-530-1600
 Website: www.wbienergy.com

WBI Energy Transmission transports natural gas. Our steel coated pipelines vary in size from 2 inches to 24 inches in diameter. The maximum operating pressures range from as little as 100 lbs. to 1,468 lbs. Our computerized gas control center monitors the system 24 hours a day and can be reached at 1-888-859-7291.

EMERGENCY RESPONSE

If a pipeline is damaged, even if the damage only appears to be minor, please notify us immediately. It is important that we evaluate and have the opportunity to repair any damage, no matter how minor.

Pipeline emergency action will begin the moment we are notified of the situation. Personnel and equipment will be dispatched to identify the emergency, control the flow of gas and make necessary repairs. We will coordinate our actions with fire, police and other public officials.

PRODUCTS TRANSPORTED IN YOUR AREA*

PRODUCT	LEAK TYPE	VAPORS
NATURAL GAS	Gas	Lighter than air and will generally rise and dissipate. May gather in a confined space and travel to a source of ignition.
HEALTH HAZARDS	Will be easily ignited by heat, sparks or flames and will form explosive mixtures with air. Vapors may cause dizziness or asphyxiation without warning and may be toxic if inhaled at high concentrations. Contact with gas or liquefied gas may cause burns, severe injury and/or frostbite.	

**EMERGENCY CONTACT:
1-888-859-7291**



PRODUCTS/DOT GUIDEBOOK ID#/GUIDE#:

Natural Gas	1971	115
-------------	------	-----

MONTANA COUNTIES OF OPERATION:

- | | |
|--------------|-------------|
| Big Horn | Prairie |
| Carbon | Richland |
| Carter | Roosevelt |
| Custer | Rosebud |
| Dawson | Stillwater |
| Fallon | Treasure |
| McCone | Valley |
| Phillips | Wibaux |
| Powder River | Yellowstone |

Changes may occur. Contact the operator to discuss their pipeline systems and areas of operation.

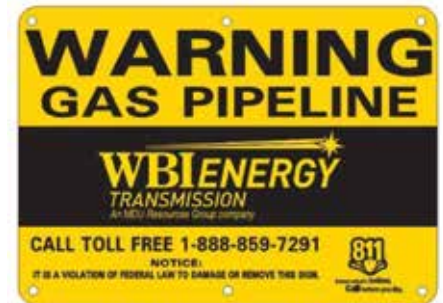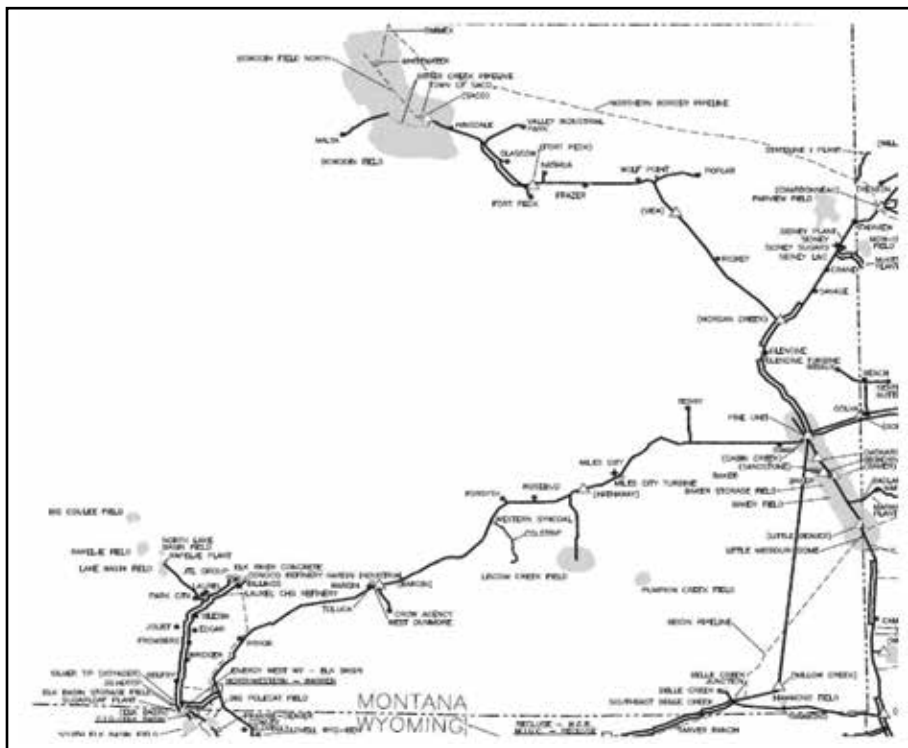

Emergency Response Plans for Gas and Hazardous Liquid Pipeline Operators

Federal regulations for both gas and hazardous liquid pipelines require operators to have written procedures for responding to emergencies involving their pipeline facility. Because pipelines are often located in public space, the regulations further require that operators include procedures for planning with emergency and other public officials to ensure a coordinated response. Please contact your local pipeline operators for information regarding their company specific emergency response plan.

Natural Gas

Each operator shall establish written procedures to minimize the hazard resulting from a gas pipeline emergency. At a minimum, the procedures must provide for the following:

- Receiving, identifying, and classifying notices of events which require immediate response by the operator.
- Establishing and maintaining adequate means of communication with appropriate fire, police, and other public officials.
- Prompt and effective response to a notice of each type of emergency, including the following:
 1. Gas detected inside or near a building.
 2. Fire located near or directly involving a pipeline facility.
 3. Explosion occurring near or directly involving a pipeline facility.
 4. Natural disaster.
- The availability of personnel, equipment, tools, and materials, as needed at the scene of an emergency.
- Actions directed toward protecting people first and then property.
- Emergency shutdown and pressure reduction in any section of the operator's pipeline system necessary to minimize hazards to life or property.
- Making safe any actual or potential hazard to life or property.
- Notifying appropriate fire, police, and other public officials of gas pipeline emergencies and coordinating with them both planned responses and actual responses during an emergency.
- Safely restoring any service outage.
- Each operator shall establish and maintain liaison with appropriate fire, police, and other public officials to:
 1. Learn the responsibility and resources of each government organization that may respond to a gas pipeline emergency;
 2. Acquaint the officials with the operator's ability in responding to a gas pipeline emergency;
 3. Identify the types of gas pipeline emergencies of which the operator notifies the officials; and
 4. Plan how the operator and officials can engage in mutual assistance to minimize hazards to life or property.

**Reference 49 CFR 192.615*

Hazardous Liquids



(a) General: Each operator shall prepare and follow for each pipeline system a manual of written procedures for conducting normal operations and maintenance activities and handling abnormal operations and emergencies. This manual shall be reviewed at intervals not exceeding 15 months, but at least once each calendar year, and appropriate changes made as necessary to insure that the manual is effective. This manual shall be prepared before initial operations of a pipeline system commence, and appropriate parts shall be kept at locations where operations and maintenance activities are conducted.

Emergencies. The manual required by paragraph (a) of this section must include procedures for the following to provide safety when an emergency condition occurs:

- Receiving, identifying, and classifying notices of events which need immediate response by the operator or notice to fire, police, or other appropriate public officials and communicating this information to appropriate operator personnel for corrective action.
- Prompt and effective response to a notice of each type emergency, including fire or explosion occurring near or directly involving a pipeline facility, accidental release of hazardous liquid or carbon dioxide from a pipeline facility, operational failure causing a hazardous condition, and natural disaster affecting pipeline facilities.
- Having personnel, equipment, instruments, tools, and material available as needed at the scene of an emergency.
- Taking necessary action, such as emergency shutdown or pressure reduction, to minimize the volume of hazardous liquid or carbon dioxide that is released from any section of a pipeline system in the event of a failure.
- Control of released hazardous liquid or carbon dioxide at an accident scene to minimize the hazards, including possible intentional ignition in the cases of flammable highly volatile liquid.
- Minimization of public exposure to injury and probability of accidental ignition by assisting with evacuation of residents and assisting with halting traffic on roads and railroads in the affected area, or taking other appropriate action.
- Notifying fire, police, and other appropriate public officials of hazardous liquid or carbon dioxide pipeline emergencies and coordinating with them preplanned and actual responses during an emergency, including additional precautions necessary for an emergency involving a pipeline system transporting a highly volatile liquid.
- In the case of failure of a pipeline system transporting a highly volatile liquid, use of appropriate instruments to assess the extent and coverage of the vapor cloud and determine the hazardous areas.
- Providing for a post accident review of employee activities to determine whether the procedures were effective in each emergency and taking corrective action where deficiencies are found.

**Reference 49 CFR 195.402*

Emergency Response

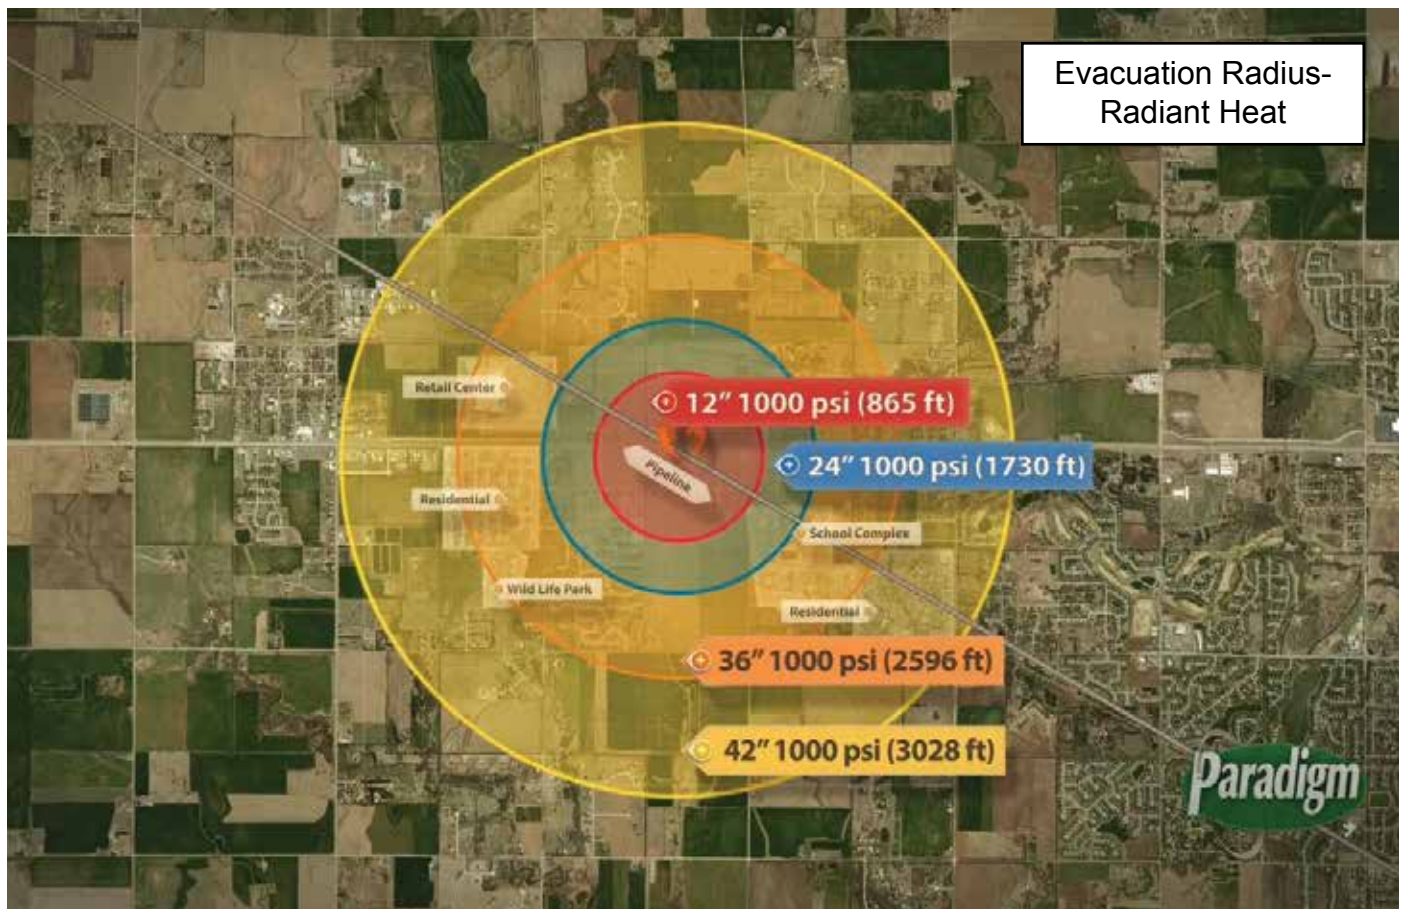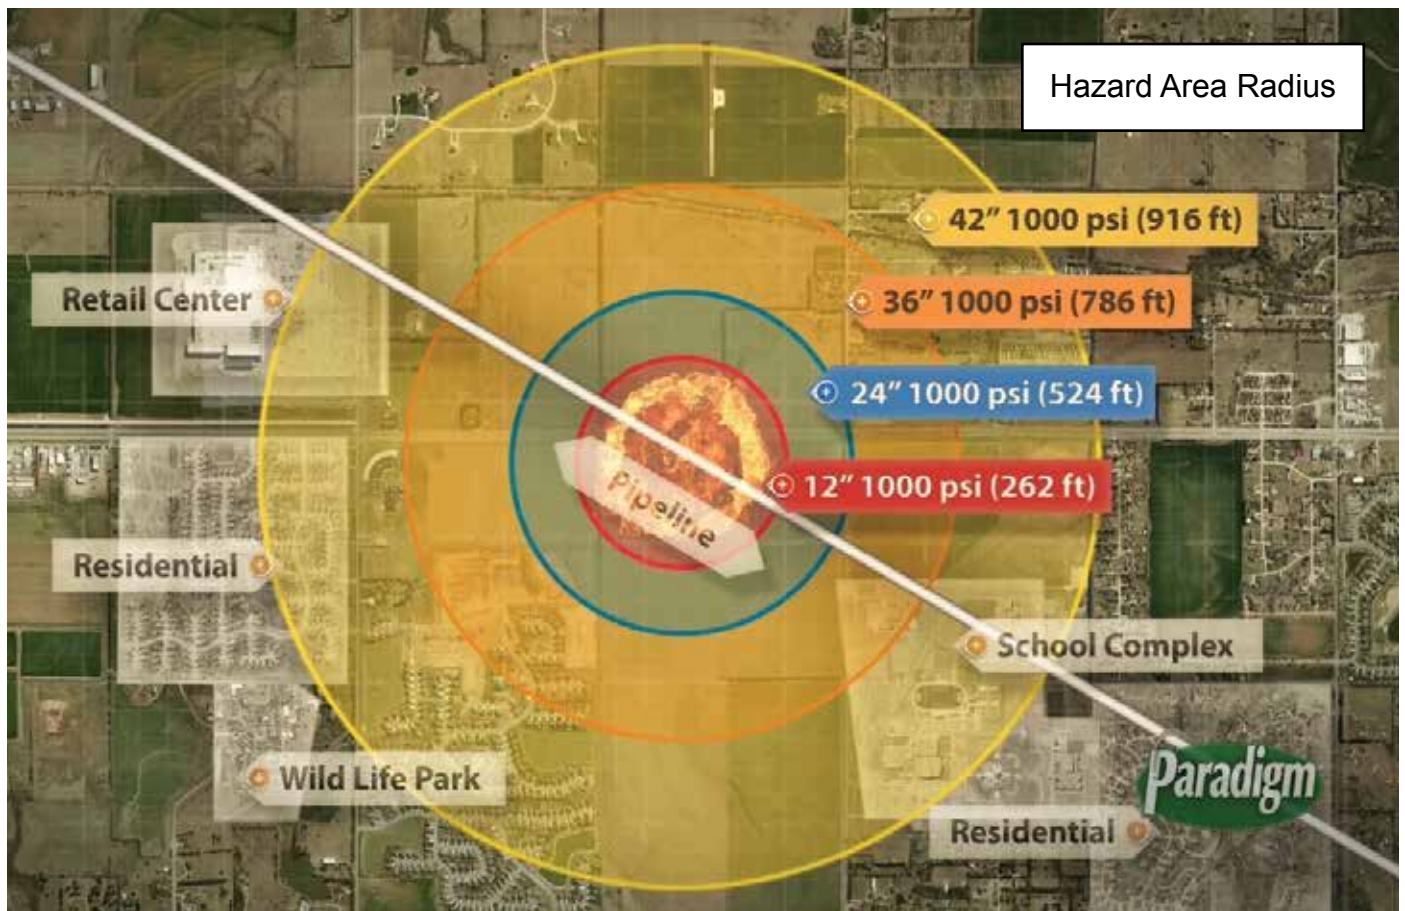

NENA Pipeline Emergency Operations - Call Intake Checklist

In accordance with NENA Pipeline Emergency Operations Standard/Model Recommendation NENA 56-007 (<https://www.nena.org/?page=PipelineEmergStnd>)

GOALS FOR INITIAL INTAKE:

1. Obtain and Verify Incident Location, Callback and Contact Information
2. Maintain Control of the Call
3. Communicate the Ability to HELP the Caller
4. Methodically and Strategically Obtain Information through Systematic Inquiry to be Captured in the Agency's Intake Format
5. Recognize the potential urgency of situations involving the release of dangerous gases or liquids related to pipelines or similar events of this nature and immediately begin the proper notifications consistent with agency policy
6. Perform all Information Entries and Disseminations, Both Initial and Update

FIRST RESPONSE CALL INTAKE CHECKLIST

The focus of this Standard is on the first minute of the call intake process. Actions taken during this time frame significantly impact the effectiveness of the response and are critical to public safety.

The following protocol is intended as a solid framework for call intake, but should not in any manner rescind or override agency procedures for the timing of broadcasts and messaging.

These procedures are established as recommended practices to consider with existing agency policy and procedure to ensure the most swift and accurate handling of every incident involving the release of dangerous gases or hazardous liquids.

All information should be simultaneously entered, as it is obtained by the telecommunicator, into an electronic format (when available) that will feed/populate any directed messages which will be sent to emergency responders in conjunction with on-air broadcasts.

Location:

Request exact location of the incident (structure addresses, street names, intersections, directional identifiers, mile posts, etc.) and obtain callback and contact information.

Determine Exactly What Has Happened:

Common signs of a pipeline leak are contained in Table 1 below. If any of these conditions are reported, THIS IS A PIPELINE EMERGENCY.

TABLE 1
Common Indications of a Pipeline Leak

Condition	Natural Gas (lighter than air)	LPG & HVL (heavier than air)	Liquids
An odor like rotten eggs or a burnt match	X	X	
A loud roaring sound like a jet engine	X	X	
A white vapor cloud that may look like smoke		X	
A hissing or whistling noise	X	X	
The pooling of liquid on the ground			X
An odor like petroleum liquids or gasoline		X	X
Fire coming out of or on top of the ground	X	X	
Dirt blowing from a hole in the ground	X	X	
Bubbling in pools of water on the ground	X	X	
A sheen on the surface of water		X	X
An area of frozen ground in the summer	X	X	
An unusual area of melted snow in the winter	X	X	
An area of dead vegetation	X	X	X

Pipelines In Our Community

According to National Transportation Safety Board statistics pipelines are the safest and most efficient means of transporting natural gas and petroleum products, which are used to supply roughly two-thirds of the energy we use. These pipelines transport trillions of cubic feet of natural gas and hundreds of billions of ton/miles of liquid petroleum products in the United States each year.

This system is comprised of three types of pipelines: transmission, distribution and gathering. The approximately 519,000 miles of transmission pipeline* transport products, including natural gas and petroleum products, across the country and to storage facilities. Compressor stations and pumping stations are located along transmission and gathering pipeline routes and help push these products through the line.

Approximately 2.2 million miles of distribution pipeline* is used to deliver natural gas to most homes and businesses through underground main and utility service lines. Onshore gathering lines are pipelines that transport gas from a current production operation facility to a transmission line or main. Production operations are piping and equipment used in production and preparation for transportation or delivery of hydrocarbon gas and/or liquids.

*mileage according to the Pipeline Hazardous Materials Safety Administration (PHMSA).

Pipeline Markers

The U.S. Department of Transportation (DOT) requires the use of signs to indicate the location of underground pipelines. Markers like these are located on road, railroad, and navigable waterway crossings. Markers are also posted along the pipeline right-of-way.

The markers display:

- The material transported
- The name of the pipeline operator
- The operator's emergency number

MARKER INFORMATION









- Indicates area of pipeline operations
- May have multiple markers in single right-of-way
- May have multiple pipelines in single right-of-way
- DOES NOT show exact location
- DOES NOT indicate depth (*never assume pipeline depth*)
- DOES NOT indicate pipeline pressure



Call Before You Dig

Statistics indicate that damage from excavation related activities is a leading cause of pipeline accidents. If you are a homeowner, farmer, excavator, or developer, we need your help in preventing pipeline emergencies.

1. Call your state's One-Call center before excavation begins - regulatory mandate as state law requires.
2. Wait the required amount of time.
3. A trained technician will mark the location of the pipeline and other utilities (private lines are not marked).
4. Respect the marks.
5. Dig with care.

American Public Works Association (APWA) Uniform Color Code	
	WHITE - Proposed Excavation
	PINK - Temporary Survey Markings
	RED - Electric Power Lines, Cables, Conduit and Lighting Cables
	YELLOW - Gas, Oil, Steam, Petroleum or Gaseous Materials
	ORANGE - Communication, Alarm or Signal Lines, Cables or Conduit
	BLUE - Potable Water
	PURPLE - Reclaimed Water, Irrigation and Slurry Lines
	GREEN - Sewers and Drain Lines

National One-Call Dialing Number:



Know what's below.
Call before you dig.

For More Details Visit: www.call811.com

Signs Of A Pipeline Release

SIGHT*

- Liquid on the ground
- Rainbow sheen on water
- Dead vegetation in an otherwise green area
- Dirt blowing into the air
- White vapor cloud
- Mud or water bubbling up
- Frozen area on ground

*Signs vary based upon product

SMELL

- Odors such as gas or oil
- Natural gas is colorless and odorless
 - Unless Mercaptan has been added (*rotten egg odor*)

OTHER - NEAR PIPELINE OPERATIONS

- Burning eyes, nose or throat
- Nausea

SOUND

- A hissing or roaring sound

What To Do If A Leak Occurs

- Evacuate immediately upwind
- Eliminate ignition sources
- Advise others to stay away
- **CALL 911** and the pipeline company – number on warning marker
 - Call collect if necessary
- Make calls from safe distance – not “hot zone”
- Give details to pipeline operator:
 - Your name
 - Your phone number
 - Leak location
 - Product activity
 - Extent of damage
- DO NOT drive into leak or vapor cloud
- DO NOT make contact with liquid or vapor
- DO NOT operate pipeline valves (*unless directed by pipeline operator*):
 - Valve may be automatically shut by control center
 - Valve may have integrated shut-down device
 - Valve may be operated by qualified pipeline personnel only, unless specified otherwise
- Ignition sources may vary – a partial list includes:
 - Static electricity
 - Metal-to-metal contact
 - Pilot lights
 - Matches/smoking
 - Sparks from telephone
 - Electric switches
 - Electric motors
 - Overhead wires
 - Internal combustion engines
 - Garage door openers
 - Firearms
 - Photo equipment
 - Remote car alarms/door locks
 - High torque starters – diesel engines
 - Communication devices

Pipeline Emergency

Call Gas Control Or Pipeline Control Center

Use *Pipeline Emergency Response Planning Information Manual* for contact information
Phone number on warning markers
Use state One-Call System, if applicable

Control Center Needs To Know

Your name & title in your organization
Call back phone number – primary, alternate
Establish a meeting place
Be very specific on the location (*use GPS*)
Provide City, County and State

Injuries, Deaths, Or Property Damage

Have any known injuries occurred?
Have any known deaths occurred?
Has any severe property damage occurred?

Traffic & Crowd Control

Secure leak site for reasonable distance
Work with company to determine safety zone
No traffic allowed through any hot zone
Move sightseers and media away
Eliminate ignition sources

Fire

Is the leak area on fire?
Has anything else caught on fire besides the leak?

Evacuations

Primary responsibility of emergency agency
Consult with pipeline/gas company

Fire Management

Natural Gas – DO NOT put out until supply stopped
Liquid Petroleum – water is NOT recommended;
foam IS recommended
Use dry chemical, vaporizing liquids, carbon dioxide

Ignition Sources

Static electricity (*nylon windbreaker*)
Metal-to-metal contact
Pilot lights, matches & smoking, sparks from phone
Electric switches & motors
Overhead wires
Internal combustion engines
Garage door openers, car alarms & door locks
Firearms
Photo equipment
High torque starters – diesel engines
Communication devices – not intrinsically safe

High Consequence Areas Identification*

Pipeline safety regulations use the concept of “High Consequence Areas” (HCAs), to identify specific locales and areas where a release could have the most significant adverse consequences. Once identified, operators are required to devote additional focus, efforts, and analysis in HCAs to ensure the integrity of pipelines.

Releases from pipelines can adversely affect human health and safety, cause environmental degradation, and damage personal or commercial property. Consequences of inadvertent releases from pipelines can vary greatly, depending on where the release occurs, and the commodity involved in the release.

What criteria define HCAs for pipelines?

Because potential consequences of natural gas and hazardous liquid pipeline releases differ, criteria for HCAs also differ. HCAs for natural gas transmission pipelines focus solely on populated areas. (Environmental and ecological consequences are usually minimal for releases involving natural gas.) Identification of HCAs for hazardous liquid pipelines focuses on populated areas, drinking water sources, and unusually sensitive ecological resources.

HCAs for hazardous liquid pipelines:

- Populated areas include both high population areas (called “urbanized areas” by the U.S. Census Bureau) and other populated areas (areas referred to by the Census Bureau as a “designated place”).
- Drinking water sources include those supplied by surface water or wells and where a secondary source of water

supply is not available. The land area in which spilled hazardous liquid could affect the water supply is also treated as an HCA.

- Unusually sensitive ecological areas include locations where critically imperiled species can be found, areas where multiple examples of federally listed threatened and endangered species are found, and areas where migratory water birds concentrate.

HCAs for natural gas transmission pipelines:

- An equation has been developed based on research and experience that estimates the distance from a potential explosion at which death, injury or significant property damage could occur. This distance is known as the “potential impact radius” (or PIR), and is used to depict potential impact circles.
- Operators must calculate the potential impact radius for all points along their pipelines and evaluate corresponding impact circles to identify what population is contained within each circle.
- Potential impact circles that contain 20 or more structures intended for human occupancy; buildings housing populations of limited mobility; buildings that would be hard to evacuate. (Examples are nursing homes, schools); or buildings and outside areas occupied by more than 20 persons on a specified minimum number of days each year, are defined as HCA’s.

* <https://primis.phmsa.dot.gov/comm/FactSheets/FSHCA.htm>

Identified Sites*

Owners and companies of gas transmission pipelines are regulated by the US Department of Transportation (DOT). According to integrity management regulations, gas pipeline companies are required to accept the assistance of local public safety officials in identifying certain types of sites or facilities adjacent to the pipeline which meets the following criteria:

- (a) A small, well-defined outside area that is occupied by twenty or more persons on at least 50 days in any twelve-month period (the days need not be consecutive). Examples of such an area are playgrounds, parks, swimming pools, sports fields, and campgrounds.
- (b) A building that is occupied by 20 or more persons on at least 5 days a week for 10 weeks in any 12 month period (the days and weeks need not be consecutive). Examples included in the definition are: religious facilities, office buildings, community centers, general stores, 4-H facilities, and roller rinks.
- (c) A facility that is occupied by persons who are confined, are of impaired mobility, or would be difficult to evacuate. Examples of such a facility are hospitals, schools, elder care, assisted living/nursing facilities, prisons and child daycares.

Sites within your jurisdiction will fit the above requirements, please go to my.spatialobjects.com/admin/register/ISR to provide this valuable information to pipeline companies.

* 49 CFR §192.903.

IDENTIFIED SITE REGISTRY

Pipeline operators need your help keeping people and property safe.

Identified Sites - locations where many people occupy an area near a pipeline asset or facility. These are places where people may gather from time to time for a variety of reasons.

Some of these sites are very difficult for companies to obtain without help from those with local knowledge of the area.

Please use the following website to gain secure access, so you can assist in identifying sites where people congregate in your community:

my.spatialobjects.com/admin/register/ISR

Pipeline operators are required by law to work with public officials who have safety or emergency response, or planning responsibilities that can provide quality information regarding identified sites.



Maintaining Safety and Integrity of Pipelines

Pipeline companies invest significant time and capital maintaining the quality and integrity of their pipeline systems. Most active pipelines are monitored 24 hours a day via manned control centers. Pipeline companies also utilize aerial surveillance and/or on-ground observers to identify potential dangers. Control center personnel continually monitor the pipeline system and assess changes in pressure and flow. They notify field personnel if there is a possibility of a leak. Automatic shut-off valves are sometimes utilized

to isolate a leak. Gas transmission and hazardous liquid pipeline companies have developed supplemental hazard and assessment programs known as Integrity Management Programs (IMPs). IMPs have been implemented for areas designated as "high consequence areas" (HCAs) in accordance with federal regulations. Specific information about companies' programs may be found on their company web sites or by contacting them directly.

How You Can Help Keep Pipelines Safe

While accidents pertaining to pipeline facilities are rare, awareness of the location of the pipeline, the potential hazards, and what to do if a leak occurs can help minimize the number of accidents. A leading cause of pipeline incidents is third-party excavation damage. Pipeline companies are responsible for the safety and security of their respective pipelines. To help maintain the integrity of pipelines and their right-of-way, it is essential that pipeline and facility neighbors protect against unauthorized excavations or other destructive activities. You can help by:

- Being aware of any unusual or suspicious activities or unauthorized excavations taking place within or near the pipeline right-of-way or pipeline facility.
 - Develop contacts and relationships with pipeline company representatives, i.e. participate in mock drill exercises with your local pipeline company.
 - Share intelligence regarding targeting of national infrastructure, and specific threats or actual attacks against pipeline companies.
- Assist with security steps for pipeline facilities during heightened national threat levels, i.e., increased surveillance near facilities.
- Monitor criminal activity at the local level that could impact pipeline companies, and anti-government/pipeline groups and other groups seeking to disrupt pipeline company activities.
- Keeping the enclosed fact sheets for future reference.
- Attending an emergency response training program in your area.
- Familiarizing yourself and your agency with the Pipelines and Informed Planning Alliance (PIPA) best practices regarding land use planning near transmission pipelines.
- Completing and returning the enclosed postage-paid survey.
- Report to the pipeline company localized flooding, ice dams, debris dams, and extensive bank erosion that may affect the integrity of pipeline crossings.

National Pipeline Mapping System (NPMS)

The National Pipeline Mapping System (NPMS) is a geographic information system created by the U.S. Department of Transportation (DOT), Pipeline and Hazardous Materials Safety Administration (PHMSA), Office of Pipeline Safety (OPS) in cooperation with other federal and state governmental agencies and the pipeline industry to provide information about companies and their pipelines. The NPMS web site is searchable by ZIP Code or by county and state, and can display a printable county map.

Within the NPMS, PHMSA has developed the Pipeline Integrity Management Mapping Application (PIMMA) for use by pipeline companies and federal, state, and

local government officials only. The application contains sensitive pipeline infrastructure information that can be viewed via internet browsers. Access to PIMMA is limited to federal, pipeline companies. PIMMA access cannot be given to any person who is not a direct employee of a government agency.

For a list of companies with pipelines in your area and their contact information, or to apply for PIMMA access, go to npms.phmsa.dot.gov. Companies that operate production facilities, gas/liquid gathering piping, and distribution piping are not represented by NPMS nor are they required to be.

Training Center

Supplemental training available for agencies and personnel that are unable to attend:

- Train as your schedule allows
- Download resources including pipeline operator specific information
 - Sponsoring pipeline operator contact information
 - Product(s) transported

- Submit Agency Capabilities Survey
 - Receive Certificate of Completion
- Visit <https://trainingcenter.pdigm.com/> to register for training



PIPELINE DAMAGE REPORTING LAW AS OF 2007

H.R. 2958 Emergency Alert Requirements

Any person, including a government employee or contractor, who while engaged in the demolition, excavation, tunneling, or construction in the vicinity of a pipeline facility;

- A. Becomes aware of damage to the pipeline facility that may endanger life or cause serious bodily harm or damage to property; or
 - B. Damages the pipeline facility in a manner that may endanger life or cause serious bodily harm or damage to property, shall promptly report the damage to the operator of the facility and to other appropriate authorities.
-

Websites:

Association of Public-Safety Communications Officials - International (APCO)

www.apcointl.org/

Common Ground Alliance

www.commongroundalliance.com

Federal Emergency Management Agency

www.fema.gov

Federal Office of Pipeline Safety

www.phmsa.dot.gov

Government Emergency Telecommunications

www.dhs.gov/government-emergency-telecommunications-service-gets

Infrastructure Protection – NIPC

www.dhs.gov/national-infrastructure-protection-plan

National Emergency Number Association

www.nena.org/?

National Fire Protection Association (NFPA)

www.nfpa.org

National Pipeline Mapping System

<https://www.npms.phmsa.dot.gov>

National Response Center

www.nrc.uscg.mil or 800-424-8802

Paradigm Liaison Services, LLC

www.pdigm.com

United States Environmental Protection Agency (EPA)

www.epa.gov/cameo

Wireless Information System for Emergency Responders (WISER)

www.wiser.nlm.nih.gov

FOR MORE INFORMATION ON THE NASFM PIPELINE EMERGENCIES PROGRAM

www.pipelineemergencies.com

FOR EMERGENCY RESPONSE INFORMATION, REFER TO DOT GUIDEBOOK.

FOR COPIES: (202) 366-4900

www.phmsa.dot.gov/hazmat/erg/emergency-response-guidebook-erg

About Paradigm

Paradigm is public awareness. We provide public awareness and damage prevention compliance services to assist with the regulatory requirements of 49 CFR 192 and 195, as well as API RP 1162. Since 2001, the oil and gas industry has worked with Paradigm to fulfill public education and community awareness requirements.

Our history of implementing public awareness programs and compliance services pre-dates API RP 1162. Most of the pipeline industry's large, mid-sized and small operators, as well as many local distribution companies utilize Paradigm's compliance services.

In serving our clients, Paradigm performs full-scope compliance programs from audience identification through effectiveness measurement. In addition, we offer consulting services for plan evaluation and continuous improvement. At the completion of each compliance program, we provide structured documentation which precisely records all elements of the program's implementation to assist with audits.

Paradigm leads the way in industry service. Pipeline operators and local distribution companies trust in Paradigm to implement their public awareness and damage prevention programs. Each year we:

- Distribute 25 million pipeline safety communications
- Compile and analyze roughly 250,000 stakeholder response surveys
- Facilitate over 1,200 liaison programs
- Implement approximately 1,000 public awareness compliance programs
- Provide audit support and assistance with over 50 public awareness audits

Contact Paradigm for more information regarding custom public awareness solutions.

Contact us:

Paradigm Liaison Services, LLC
PO Box 9123
Wichita, KS 67277
(877) 477-1162
Fax: (888) 417-0818
www.pdigm.com



HSEEP
Homeland Security Exercise
and Evaluation Program

Presenter/Contact Information:

Key Take-Aways:

✓
✓
✓
✓
✓

Comments to Remember

Questions to Ask

New Concepts to Explore



Calling 811 is the most important step!

One easy call gets your utility lines marked and helps protect you from injury and expense. Whether you are planning to do it yourself or hire a professional, smart digging means calling 811 before each job.

Visit call811.com for more information

MONTANA

Montana811: 800-424-5555 or 811
Website: www.montana811.org **Hours:** 24 hours, 365 days
Tickets Fax: 800-424-5555
Advance Notice: 2 business days
Marks Valid: 30 days
Law Link: <https://www.montana811.org/resources/montana-dig-law/>

TICKETS			STATE LAWS & PROVISIONS								NOTIFICATION EXEMPTIONS					NOTIFICATIONS ACCEPTED						
FAX	Online	Mobile	Statewide Coverage	Civil Penalties	Emergency Clause	Mandatory Membership	Excavator Permits Issued	Mandatory Premarks	Positive Response	Hand Dig Clause	Damage Reporting	DOT	Homeowner	Railroad	Agriculture	Depth	Damage	Design	Emergency	Overhead	Large Projects	Tolerance Zone
N	Y	Y	Y	Y	Y	Y	N	N	N	N	Y	N	N	N	N	N	Y	Y	Y	N	N	18"



1.877.477.1162 • mlgpa.pipeline-awareness.org